

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 1 of 34



CUSTOMER NAME: JCC LIGHTING PRODUCTS
 ADDRESS: CHICHESTER BUSINESS PARK, CITY FIELDS WAY, TANGMERE,
 CHICHESTER, WEST SUSSEX, PO20 2FT

Sample Name : LED FIRE RATED DOWNLIGHT

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

Date of Receipt : Aug 30, 2022
 Testing Start Date : Aug 30, 2022
 Testing End Date : Sep 20, 2022
 Test result(s) : For further details, please refer to the following page(s)
 (Unless otherwise stated the results shown in this test report refer only to the sample(s) tested)

Signed for
 SGS-CSTC Standards Technical
 Services Co., Ltd Xiamen Branch
 Testing Center

Bryan

Bryan Hong
 Authorized signatory



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Standards Technical Services Co., Ltd.
 Xiamen Branch Testing Center Commercial Construction Material Laboratory

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
 中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 2 of 34

SUMMARY

To determine the fire resistance of a timber floor assembly protected by a plasterboard ceiling designed to provide 30 minutes fire resistance, incorporating 12 LED FIRE RATED DOWNLIGHT fittings, when tested in accordance with BS EN 1365-2: 2014, "Fire resistance tests for loadbearing elements Part 2: Floors and roofs".

Test Results:

Loadbearing Capacity:	30min (No failure)
Integrity:	sustained flaming: 30min (No failure)
	Gap gauge: 30min (No failure)
	Cotton pad: 30min (No failure)
Insulation:	30min (No failure)

Note: According to sponsor requirements, the test was discontinued after a period of 30 minutes.

Summary of Tested Assembly

The timber floor assembly had overall nominal dimensions of 4800 mm long by 3230 mm wide and comprised solid wood joists at 600mm centres. The depth of the solid wood joist was 195mm. The upper surface of the floor comprised nominally 22mm thick T&G chipboard and screwed fixed to the upside of the floor joists. The floor assembly was protected on its underside by a direct fixed ceiling, formed from one layer of 15mm thick Standard Gypsum Boards, the ceiling was screw fixed to the underside of the floor joists.

The floor supported a uniformly distributed load of 1080N/m². This load value was specified by the sponsor of the test.



SGS-CTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编: 361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 3 of 34

The ceiling incorporated 12 LED FIRE RATED DOWNLIGHT fittings referenced as follows:

Test Ref.	Product Name	Reference
A	Fireguard Next Generation	JC010023 WH/CH/BN/BLK
B	V50	JC1017
C	Fireguard Next Generation	JC010035 WH/CH/BN/BLK
D	V50	JC1002 with JC1004
E	V50	JC1010
F	V50	JC1013
G	V50	JC1015
H	Fireguard Next Generation	JC010028 WH/CH/BN/BLK
I	V50	JC1019
J	V50	JC1026
K	V50	JC 1001 with JC1003
L	Fireguard Next Generation	JC010033 WH/CH/BN/BLK



SGS-CTC (Shanghai) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 4 of 34

SCHEDULE OF COMPONENTS

(Refer to Figures 1 to 14)

(All values are nominal unless stated otherwise, all other details are as stated by the sponsor)

<u>Item</u>	<u>Description</u>
1. Floor Joists	
Material	: Solid Timber Joist, softwood
Size	: 195mm deep; 45mm thick
Centres:	: 600mm
2. Floorboards	
Material	: Egger T&G chipboard
Thickness	: 1 No. layer, 22mm thick
Fixing method	: All board screw fixed to all joists using drywall steel screws, at 200 mm centers along joists and 150 mm centers along perimeter of floor.
3. Ceiling boards	
Material	: Knauf Standard Gypsum Board
Thickness	: 1 No. layer, 15mm thick
Fixing method	: All board fixed to joists with Drywall screws at max.230mm c/c. The joints between the boards were filled with joint filler with was also used to cover the heads of the screws.
4. End Joists	
Material	: Glulam
Size	: 195mm high x 50mm thick
Fixing method	: Fitted across the ends of the joists and through screwed to each joist.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn
 中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 5 of 34

5.Specimen 'A'

Product Name : Fireguard Next Generation
 Reference : JC010023 WH/CH/BN/BLK Fireguard Tilt Downlight
 Manufacturer : JCC Lighting Products
 Type : Fireguard Recessed Downlight
 Overall dimensions and construction : 101mm (H) x 100mm (Φ), See figure 3
 Hole size in ceiling boards : 84mm Φ
 Materials :
 i: Casing: Mild Steel
 ii: Cover: Aluminum
 iii: Spring clip: Steel
 iv: Connection Block: Polycarbonate Housing
 Approx. weight: 0.261 Kg

Details of fireproof material:
 i: Manufacturer: JCC Lighting Products
 ii: Type: Mild Steel 'can'
 iii: Thickness: 0.8mm
 iv: Location: Main chassis

6.Specimen 'B'

Product Name : V50
 Reference : V50 Slim Converter 72-165mm
 Manufacturer : JCC Lighting products
 Type : JC1017
 Overall dimensions and construction : 63mm H x 170mm W, See figure 4
 Hole size in ceiling boards : 150mm
 Materials :
 i: Casing: Mild Steel (can)
 ii: Cover: Aluminum (bezel)
 iii: Spring clip: Sprung Steel
 iv: Connection Block: Polycarbonate (housing)
 Approx. weight: 0.30 Kg

Details of fireproof material:
 i: Manufacturer: JCC Lighting products
 ii: Type: Mild Steel (can)
 iii: Thickness: 1.1mm (painted)



SGS-CSTC (Singapore) Technical Services Co., Ltd.
 Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
 中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 6 of 34

Details of expanding material:

- iv: Location: Main chassis
- i: Manufacturer: JCC Lighting products
- ii: Type: Disc
- iii: Material: Graphite based intumescent
- iv: Thickness: 0.89mm
- v: Location: Top of steel can

7.Specimen 'C'

Product Name : Fireguard Next Generation
 Reference : JC010035 WH/CH/BN/BLK Fireguard Downlight
 Manufacturer : JCC Lighting Products
 Type : Fireguard IP65 Recessed Downlight
 Overall dimensions and construction : 98mm (H) x 94mm (Φ), See figure 5
 Hole size in ceiling boards : 80mm Φ
 Materials :
 i: Casing: Mild Steel
 ii: Cover: Aluminum
 iii: Spring clip: Steel
 iv: Connection Block: Polycarbonate Housing
 Approx. weight: 0.261 Kg

Details of fireproof material:

- i: Manufacturer: JCC Lighting Products
- ii: Type: Mild Steel 'can'
- iii: Thickness: 0.8mm
- iv: Location: Main chassis

8.Specimen 'D'

Product Name : V50
 Reference : V50 Converter plate for use with JC1002
 Manufacturer : JCC Lighting Products
 Type : JC1002 with JC1004
 Overall dimensions and construction : 46mm H x 170mm W, See figure 6
 Hole size in ceiling boards : 140mm
 Materials :
 i: Casing: Mild Steel (can)
 ii: Cover: Aluminum (bezel)



SGS-CTC (Shanghai) Technical Services Co., Ltd.
 Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
 中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 7 of 34

iii: Spring clip: Sprung Steel
Approx. weight: 0.32 Kg

Details of fireproof material: i: Manufacturer: JCC Lighting Products
ii: Type: Intumescent Material
iii: Thickness: 0.89mm
iv: Location: Main chassis

Details of expanding material: i: Manufacturer: JCC Lighting Products
ii: Type: Disc
iii: Material: Graphite based intumescent
iv: Thickness: 0.89mm
v: Location: Rear of main chassis

9.Specimen 'E'

Product Name : V50
Reference : V50 Fire rated downlight
Manufacturer : JCC Lighting products
Type : JC1010
Overall dimensions and construction : 54mm H x 84mm W, See figure 7
Hole size in ceiling boards : 70mm
Materials: i: Casing: Mild Steel (can)
ii: Cover: Aluminum (bezel)
iii: Spring clip: Sprung Steel
iv: Connection Block: Polycarbonate (housing)
Approx. weight: 0.29 Kg

Details of fireproof material: i: Manufacturer: JCC Lighting products
ii: Type: Mild Steel (can)
iii: Thickness: 1.1mm (painted)
iv: Location: Main chassis

Details of expanding material: i: Manufacturer: JCC Lighting products
ii: Type: Disc
iii: Material: Graphite based intumescent
iv: Thickness: 0.89mm



SGS-CTC (Shanghai) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 8 of 34

10.Specimen 'F'

Product Name : V50

Reference : V50 Slim 72-100mm Converter Bezel

Manufacturer : JCC Lighting products

Type : JC1013

Overall dimensions and construction : 54mm H x 100mm W, See figure 8

Hole size in ceiling boards : 80mm

Materials :
i: Casing: Mild Steel (can)
ii: Cover: Aluminum (bezel)
iii: Spring clip: Sprung Steel
iv: Connection Block: Polycarbonate (housing)
Approx. weight: 0.32 Kg

Details of fireproof material:
i: Manufacturer: JCC Lighting products
ii: Type: Mild Steel (can)
iii: Thickness: 1.1mm (painted)
iv: Location: Main chassis

Details of Expanding material:
i: Manufacturer: JCC Lighting products
ii: Type: Disc
iii: Material: Graphite based intumescent
iv: Thickness: 0.89mm
v: Location: Top of steel can

11.Specimen 'G'

Product Name : V50

Reference : V50 Pro Retrofit 135mm Firerated LED Downlight

Manufacturer : JCC Lighting Products

Type : JC1015

Overall dimensions and construction : 54mm H x 135mm W, See figure 9

Hole size in ceiling boards : 100mm

Materials :
i: Casing: Mild Steel (can)
ii: Cover: Aluminum (bezel)



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 9 of 34

iii: Spring clip: Sprung Steel
iv: Connection Block: Polycarbonate (housing)
Approx. weight: 0.37 Kg
Details of fireproof material:
i: Manufacturer: JCC Lighting products
ii: Type: Mild Steel (can)
iii: Thickness: 1.1mm (painted)
iv: Location: Main chassis
Details of Expanding material
i: Manufacturer: JCC Lighting products
ii: Type: Disc
iii: Material: Graphite based intumescent
iv: Thickness: 0.89mm
v: Location: Top of steel can

12.Specimen 'H'

Product Name : Fireguard Next Generation
Reference : JC010028 WH/CH/BN/BLK
Manufacturer : JCC Lighting Products
Type : Fireguard IP65 Recessed Downlight
Overall dimensions and construction : 85mm (H) x 86mm (Φ), See figure 10
Hole size in ceiling boards : 74mm Φ
Materials
i: Casing: Mild Steel
ii: Cover: Aluminum
iii: Spring clip: Steel
iv: Connection Block: Polycarbonate Housing
Approx. weight: 0.2 Kg
Details of fireproof material:
i: Manufacturer: JCC Lighting Products
ii: Type: Mild Steel 'can'
iii: Thickness: 0.8mm
iv: Location: Main chassis

13.Specimen 'I'

Product Name : V50
Reference : V50 Slim Anti-Glare LED Downlight



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Inspection & Testing Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 10 of 34

Manufacturer : JCC Lighting Products

Type : JC1019

Overall dimensions and construction : 107mm H x 85mm W, See figure 11

Hole size in ceiling boards : 80mm

Materials

- i: Casing: Mild Steel (can)
- ii: Cover: Aluminum (bezel)
- iii: Spring clip: Sprung Steel
- iv: Connection Block: Polycarbonate (housing)

Approx. weight: 0.32 Kg

Details of fireproof material:

- i: Manufacturer: JCC Lighting products
- ii: Type: Mild Steel (can)
- iii: Thickness: 1.1mm (painted)
- iv: Location: Main chassis

Details of Expanding material

- i: Manufacturer: JCC Lighting products
- ii: Type: Disc
- iii: Material: Graphite based intumescent
- iv: Thickness: 0.89mm
- v: Location: Top of steel can

14.Specimen 'J'

Product Name : V50

Reference : V50 Pro Tilt Fire-rated LED Downlight

Manufacturer : JCC Lighting Products

Type : JC1026

Overall dimensions and construction : 63mm H x 100mm W, See figure 12

Hole size in ceiling boards : 80mm

Materials

- i: Casing: Mild Steel (can)
- ii: Cover: Aluminum (bezel)
- iii: Spring clip: Sprung Steel
- iv: Connection Block: Polycarbonate (housing)

Approx. weight: 0.36 Kg

Details of fireproof material:

- i: Manufacturer: JCC Lighting products



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 11 of 34

Details of Expanding material

- ii: Type: Mild Steel (can)
- iii: Thickness: 1.1mm (painted)
- iv: Location: Main chassis
- i: Manufacturer: JCC Lighting products
- ii: Type: Disc
- iii: Material: Graphite based intumescent
- iv: Thickness: 0.89mm
- v: Location: Top of steel can

15.Specimen 'K'

- Product Name : V50
- Reference : V50 Converter plate for use with JC1001
- Manufacturer : JCC Lighting Products
- Type : JC 1001 with JC1003
- Overall dimensions and construction : 46mm H x 170mm W, See figure 13
- Hole size in ceiling boards : 115mm
- Materials : i: Casing: Mild Steel (can)

- ii: Cover: Aluminum (bezel)
- iii: Spring clip: Sprung Steel
- Approx. weight: 0.29Kg

Details of fireproof material:

- i: Manufacturer: JCC Lighting Products
- ii: Type: Intumescent Material
- iii: Thickness: 0.89mm
- iv: Location: Main chassis

Details of Expanding material

- i: Manufacturer: JCC Lighting Products
- ii: Type: Disc
- iii: Material: Graphite based intumescent
- iv: Thickness: 0.89mm
- v: Location: Rear of main chassis

16.Specimen 'L'

- Product Name : Fireguard Next Generation
- Reference : JC010033 WH/CH/BN/BLK Fireguard Downlight



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CTC (Shanghai) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 12 of 34

Manufacturer : JCC Lighting Products

Type : Fireguard Recessed Downlight

Overall dimensions and construction : 101mm (H) x 100mm (s), See figure 14

Hole size in ceiling boards : 84mm s

Materials

- i: Casing: Mild Steel
- ii: Cover: Aluminum
- iii: Spring clip: Steel
- iv: Connection Block: Polycarbonate Housing

Approx. weight: 0.261 Kg

Details of fireproof material:

- i: Manufacturer: JCC Lighting Products
- ii: Type: Mild Steel 'can'
- iii: Thickness: 0.8mm
- iv: Location: Main chassis



SGS-CSTC 检测技术有限公司
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 13 of 34

TEST PROCEDURE

The ambient temperature at the beginning of the test was 31 °C.

The furnace temperature was measured by means of nine thermocouples distributed evenly in the furnace, and each thermocouple shall be (100 ± 50) mm from the nearest point of exposed face of the specimen. The furnace was controlled so that the mean of the nine thermocouple readings followed as closely as possible the time/temperature relationship specified Clause 5.1 of BS EN 1363-1: 2020.

The pressure distribution over the height of a furnace is mainly influenced by natural buoyancy effect of the gases. For the purpose of controlling the pressure, it can be assumed that the pressure gradient will be approximately 8.5 Pa per meter height of furnace. The furnace shall be operated so that the neutral pressure plane (a pressure of zero) is established 500 mm above nominal floor level.

Thermocouples were provided to monitor the unexposed surface of the floor assembly and the output of all instrumentation was recorded at no less than one-minute intervals. The locations and reference numbers of the various unexposed surface and internal thermocouples are shown in Figure 1..

TEST DATA AND INFORMATION

Details of the specimen structure are shown in Figure 1 to 14. The photographs of the LED FIRE RATED DOWNLIGHT are shown in Photo 1 to 24

Photographs of the test are shown in Photos 25 to 31. A summary of the observations made on the general behavior of the specimen is given in Appendix 1.

The mean furnace temperature records are shown in Appendix 2, and the actual time-temperature curve of furnace in relation to the specified time-temperature curve is shown in Figure 15.

The unexposed surface temperature records are shown in Appendix 3, and the individual temperatures recorded adjacent to the spotlight fittings at mid-height of the cavity are shown in Appendix 4. The unexposed surface maximum and mean temperature curve are shown in Figure 16. The vertical deflection at the centre of the floor assembly was continuously measured during the test, and the data records are given in Appendix 5. The deflection curve is shown in Figure 17.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Xiamen Branch Testing Center Commercial Construction Material Laboratory

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 14 of 34

PERFORMANCE CRITERIA

This test was according to performance criteria which specified in BS EN 1365-2: 2014, section 11 to determine the loadbearing capacity, integrity and insulation of the specimen:

Loadbearing capacity:

The following definitions are used for flexural loaded elements:

$$\text{Limiting deflection} \quad D_{\text{limit}} = \frac{L^2}{400d} \text{ mm}$$

$$\text{Limiting rate of deflection} \quad \left(\frac{dD}{dt}\right)_{\text{limit}} = \frac{L^2}{9000d} \text{ mm/min}$$

Where

L is the clear span of the test specimen, in millimetres;

d is the distance from the extreme fibre of the cold design compression zone to the extreme fibre of the cold design tension zone of the structural section, in millimetres.

For the purposes of this standard, failure to support the test load is deemed to have occurred when:

(i) measured deflection $\geq 1.5 \times D_{\text{limit}}$; or (ii) D_{limit} and $(dD/dt)_{\text{limit}}$ are exceeded

In this test:

$$\text{Limiting deflection} \quad D_{\text{limit}} = \frac{(4500)^2}{400 \times 232} = 218 \text{ (mm)}$$

$$\text{Limiting rate of deflection} \quad \left(\frac{dD}{dt}\right)_{\text{limit}} = \frac{(4500)^2}{9000 \times 232} = 9.7 \text{ (mm/min)}$$

$$1.5 \times \text{limiting deflection} \quad 1.5D_{\text{limit}} = 1.5 \times 218 = 327 \text{ (mm)}$$

Integrity:

These are the times in completed minutes for which the test specimen continues to maintain its separating function during the test without.

- a) causing the ignition of cotton pad.
- b) permitting the 6 mm diameter gap gauge to be passed through the test specimen, such that the gauge projects into the furnace, and can be moved a distance of 150 mm along the gap; or
- c) permitting the 25 mm diameter gap gauge to be passed through the test specimen such that the gauge projects into the furnace.
- d) resulting in sustained flaming.



SGS-CSTC Xi'an Branch Testing Center
Xian Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 15 of 34

Insulation:

This is the time in completed minutes for which the test specimen continues to maintain its separating function during the test without developing temperatures on its unexposed surface which:

- a) increase the average temperature above the initial average temperature by more than 140°C; or
- b) increase at any location (including the roving thermocouple) above the initial average temperature by more than 180°C.

CONCLUSIONS

A specimen of a timber floor assembly protected by a plasterboard ceiling incorporating 12 LED FIRE RATED DOWNLIGHT fittings has been subjected to a fire resistance test in accordance with BS EN 1365-2: 2014.

At the heating period of 30 minutes, the maximum deflection was 17.7mm; the rate of deflection was 0.4 mm/min. The loadbearing capacity was satisfied.

At the heating period of 30 minutes, there was no collapse of the specimen, no sustained flaming on the unexposed surface and no loss of impermeability. The integrity requirement was satisfied.

At the heating period of 30 minutes, the mean temperature rise of the unexposed face was 30.4°C, the max temperature rise of the unexposed face was 33.7°C. The insulation requirement was satisfied.

The floor assemblies satisfied the performance requirements specified in Clause 7 of BS EN 1365-2: 2014, for the following periods:

Loadbearing Capacity:	30min (No failure)
Integrity:	sustained flaming: 30min (No failure)
	Gap gauge: 30min (No failure)
	Cotton pad: 30min (No failure)
Insulation:	30min (No failure)

Note:

According to sponsor requirements, the test was discontinued after a period of 30 minutes.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 16 of 34

TEST PHOTOGRAPHS



Photo 1: Front view of specimen 'A'



Photo 2: Side view of specimen 'A'



Photo 3: Front view of specimen 'B'



Photo 4: Side view of specimen 'B'



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 17 of 34



Photo 5: Front view of specimen 'C'



Photo 6: Side view of specimen 'C'



Photo 7: Front view of specimen 'D'



Photo 8: Side view of specimen 'D'



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编: 361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 18 of 34



Photo 9: Front view of specimen 'E'



Photo 10: Side view of specimen 'E'



Photo 11: Front view of specimen 'F'



Photo 12: Side view of specimen 'F'



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编: 361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 19 of 34



Photo 13: Front view of specimen 'G'



Photo 14: Side view of specimen 'G'



Photo 15: Front view of specimen 'H'



Photo 16: Side view of specimen 'H'



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编: 361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 20 of 34



Photo 17: Front view of specimen 'I'



Photo 18: Side view of specimen 'I'



Photo 19: Front view of specimen 'J'



Photo 20: Side view of specimen 'J'



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 21 of 34



Photo 21: Front view of specimen 'K'



Photo 22: Side view of specimen 'K'



Photo 23: Front view of specimen 'L'



Photo 24: Side view of specimen 'L'



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编: 361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

Member of the SGS Group (SGS SA)

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 22 of 34



Photo 25: The exposed surface of the specimen before the test



Photo 26: The unexposed surface of the specimen before the test.



Photo 27: The exposed surface of the specimen after test duration of 3 minutes, showing the lens of specimen was fusing.

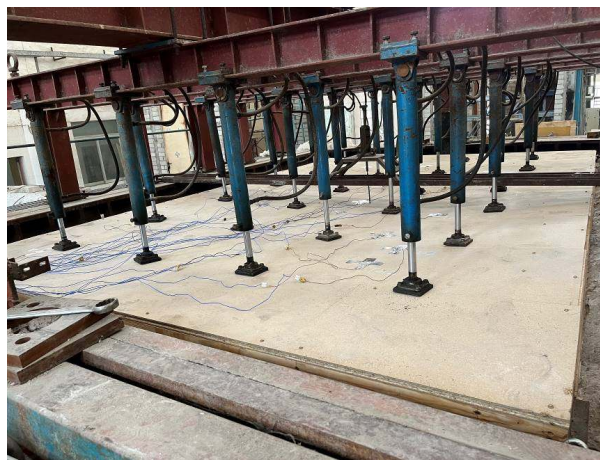


Photo 28: The unexposed surface of the specimen after test duration of 15 minutes.

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 23 of 34



Photo 29: The exposed surface of the specimen after test duration of 16 minutes, large areas of coating of the plasterboard ceiling fell away.



Photo 30: The unexposed surface of the specimen after test duration of 30 minutes.



Photo 31: The unexposed surface of the specimen after the test.

/



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com


TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 24 of 34

DETAILS OF TEST SPECIMEN

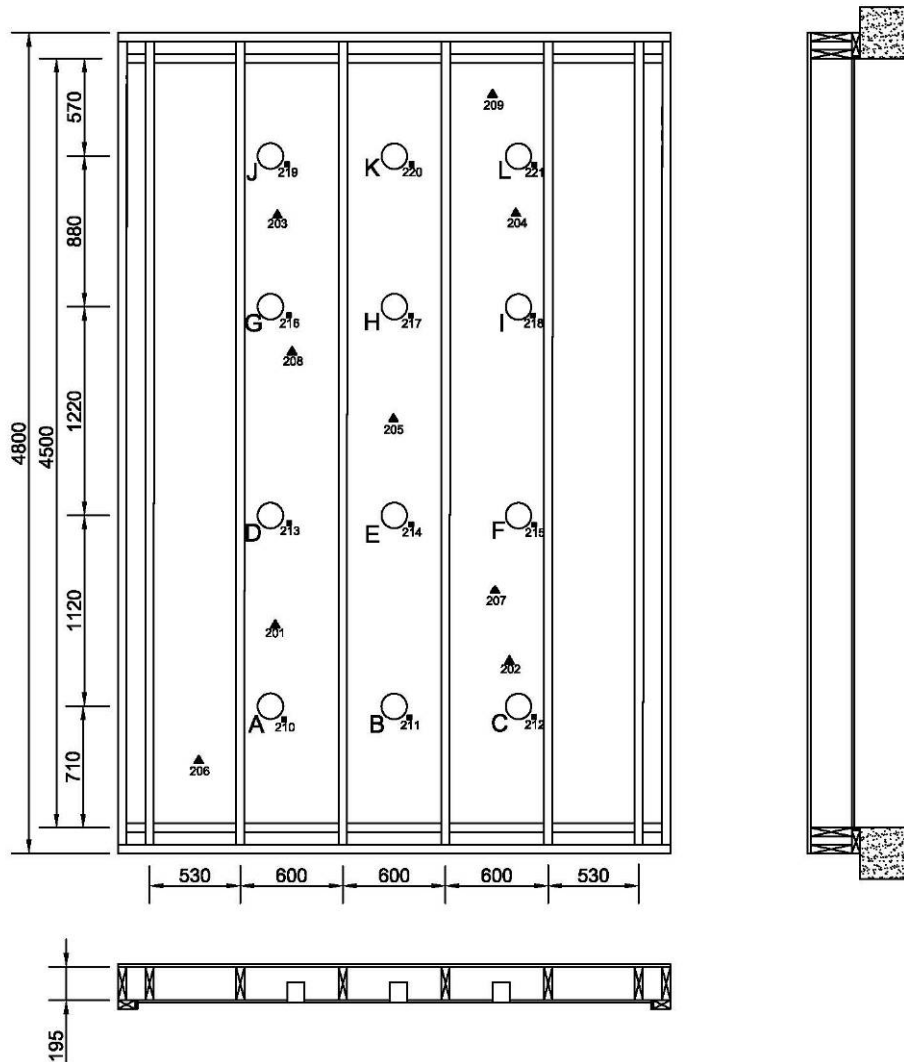

Joists Layout

Figure 1 - Specimen General Plan



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC Xiamen Branch
Xiamen Branch Testing Center Commercial Construction Material Laboratory


No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT


No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 25 of 34

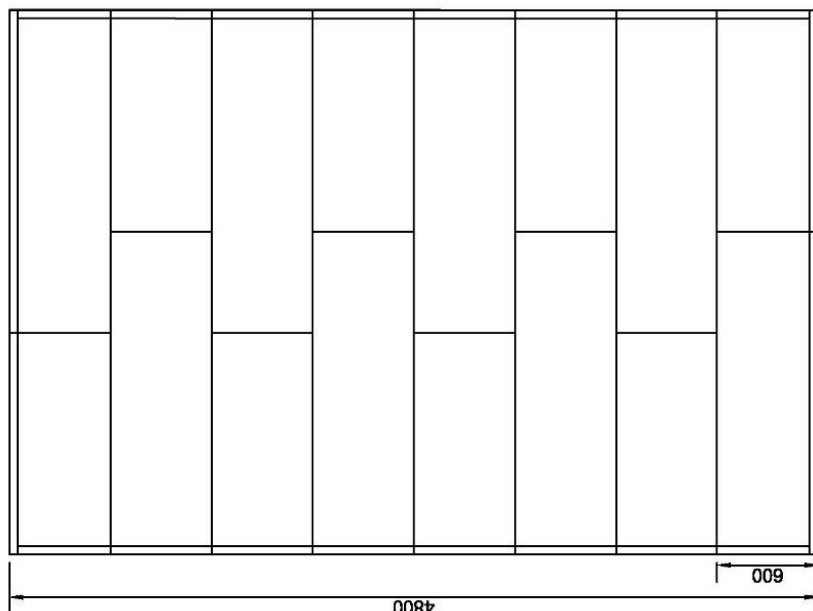

Chipboard Layout

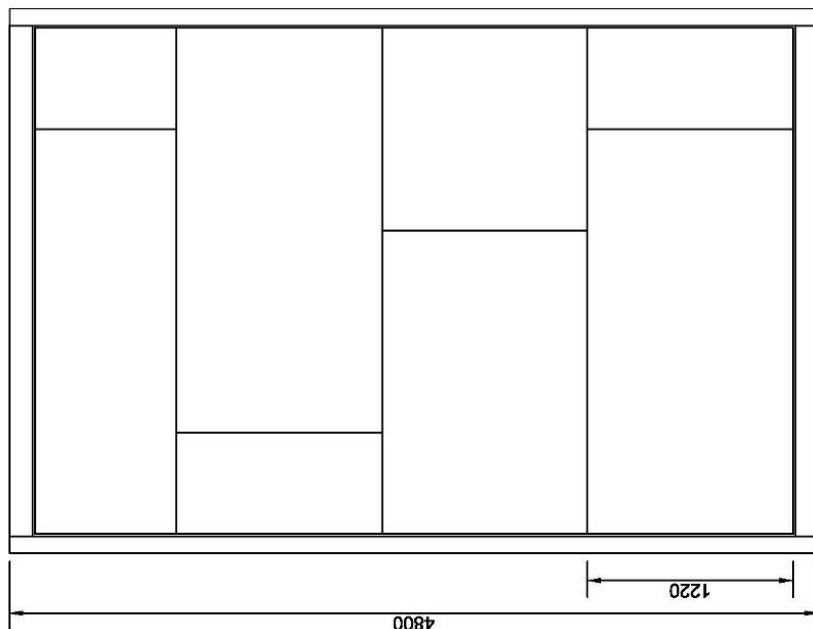

Plasterboard Layout

Figure 2 - Specimen Structural Drawing

Note: the specimen details provided by the sponsor



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 26 of 34

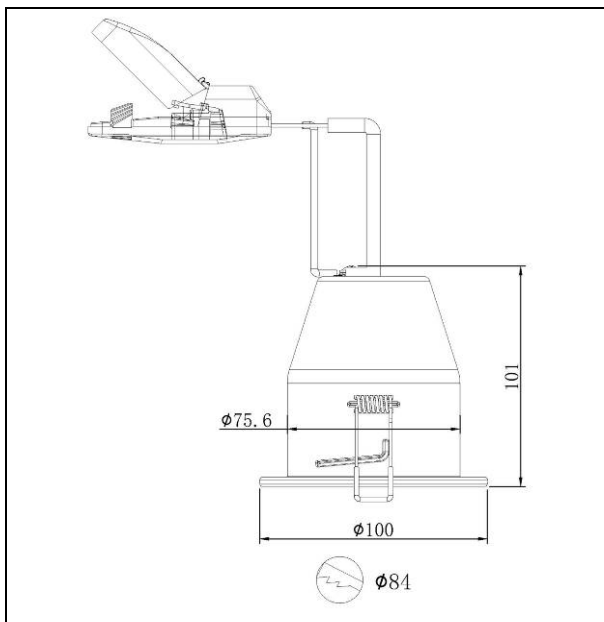


Figure 3 – Details of specimen 'A'

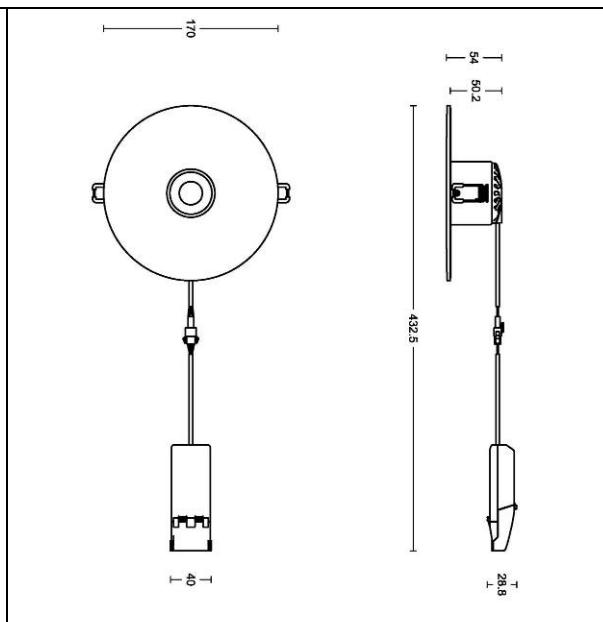


Figure 4 – Details of specimen 'B'

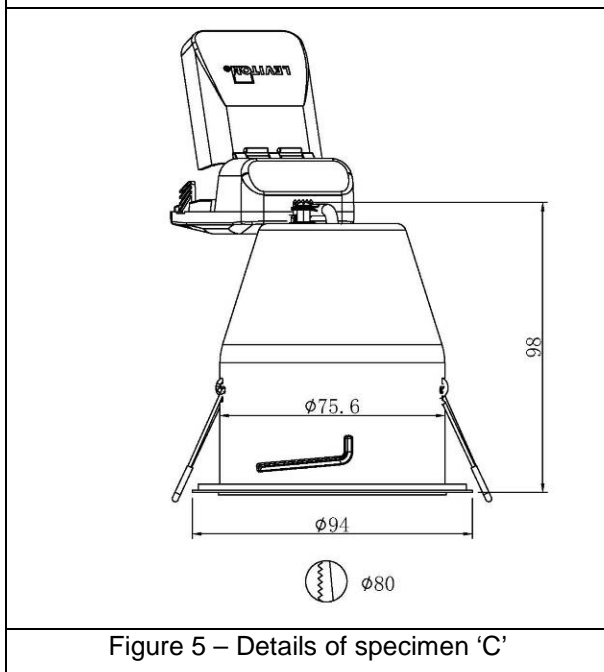


Figure 5 – Details of specimen 'C'

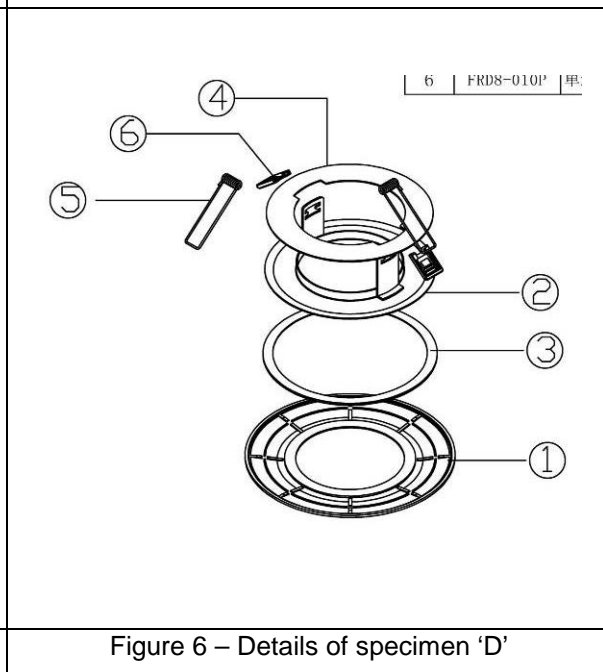


Figure 6 – Details of specimen 'D'



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 27 of 34

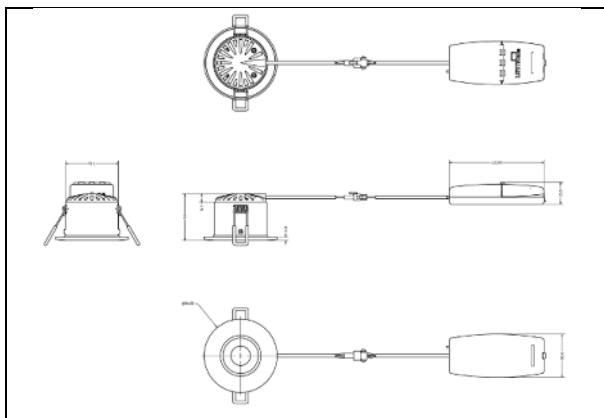


Figure 7 – Details of specimen 'E'

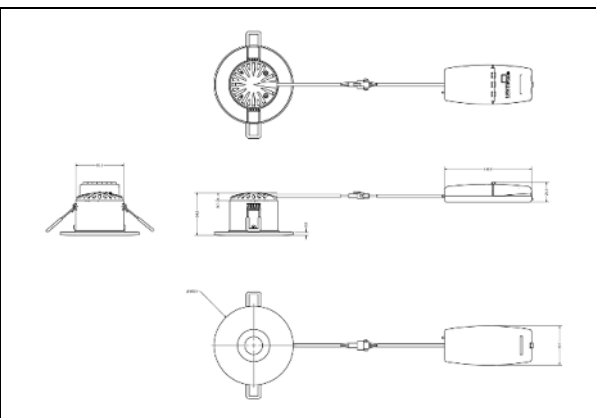


Figure 8 – Details of specimen 'F'

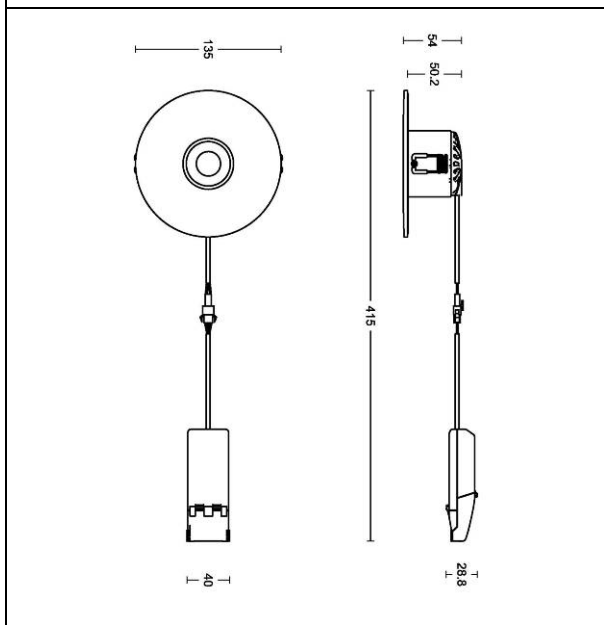


Figure 9 – Details of specimen 'G'

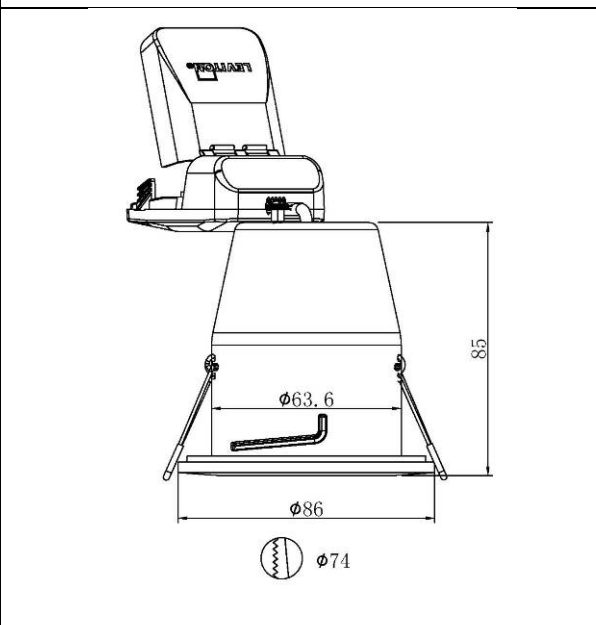


Figure 10 – Details of specimen 'H'



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory





No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 28 of 34

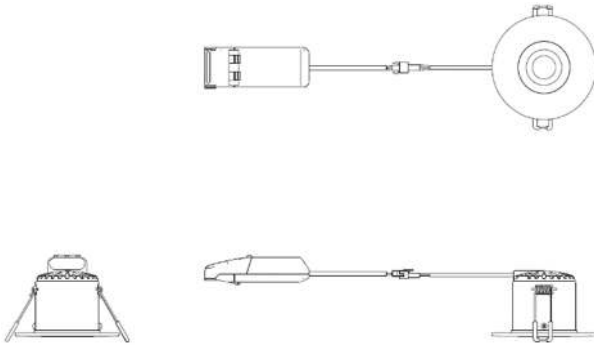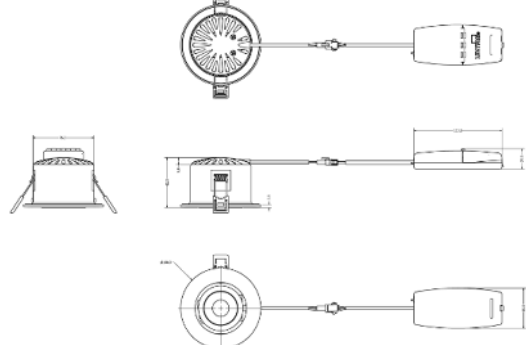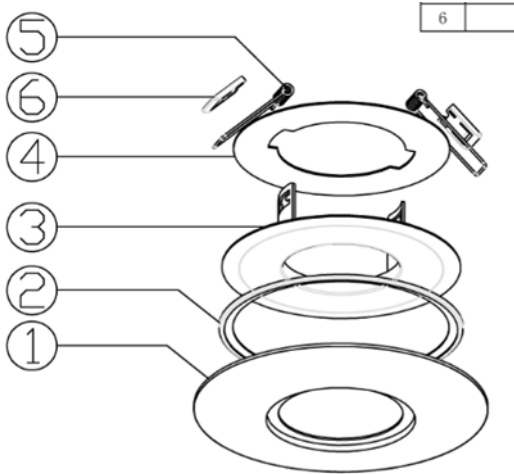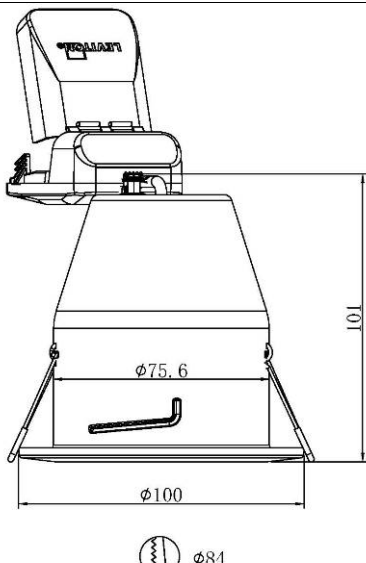	
<p>Figure 11 – Details of specimen 'I'</p>	<p>Figure 12 – Details of specimen 'J'</p>
	
<p>Figure 13 – Details of specimen 'K'</p>	<p>Figure 14 – Details of specimen 'L'</p>

Note: the specimen details provided by the sponsor



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 29 of 34

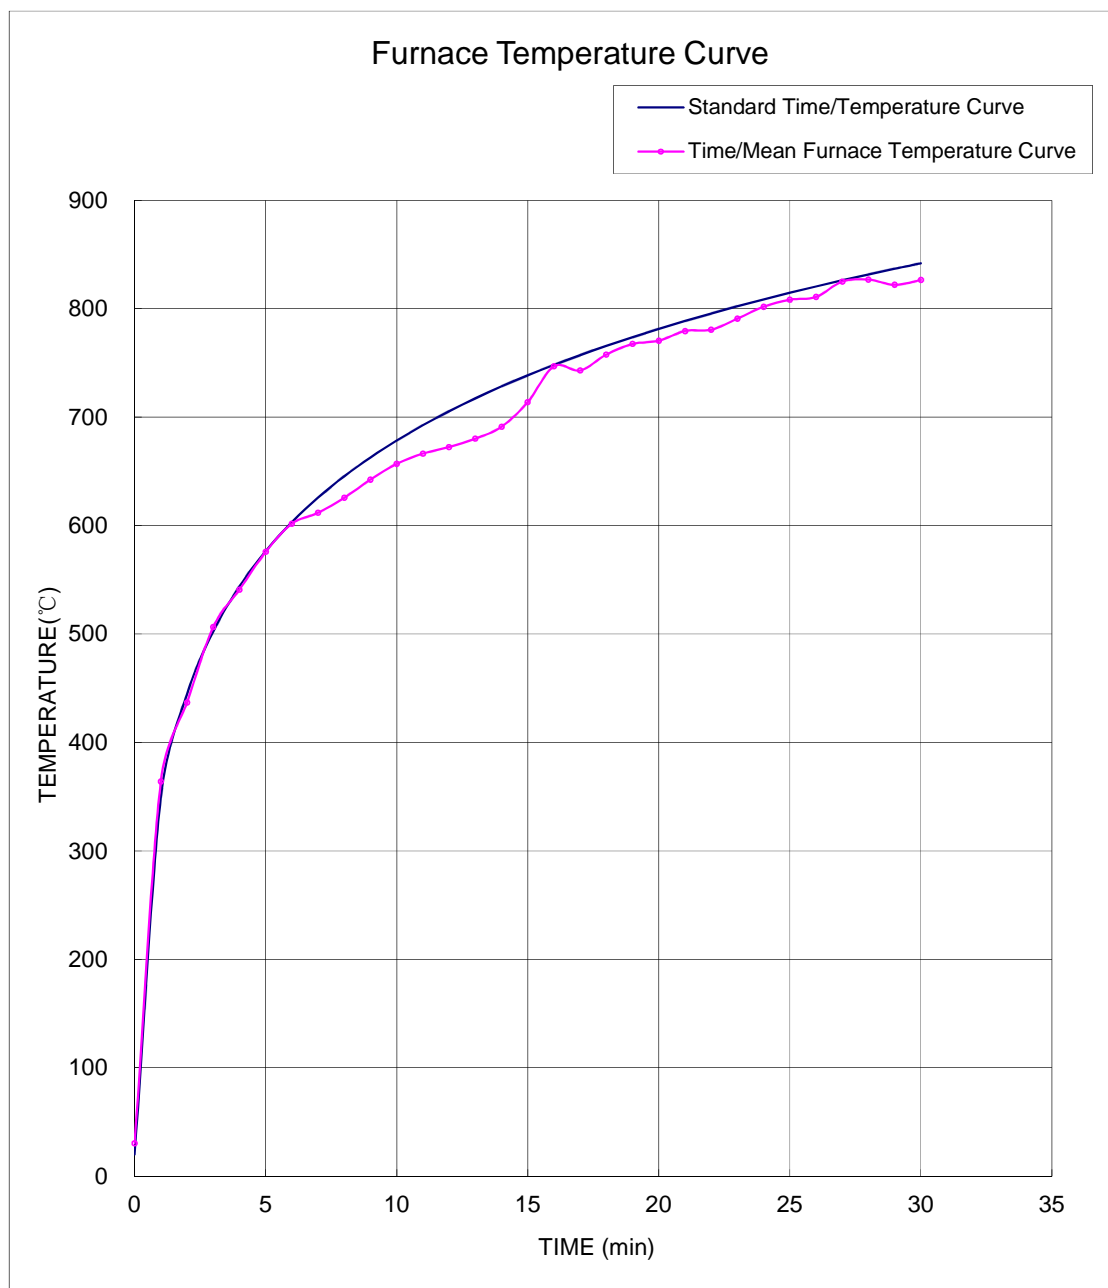


Figure 15 - Furnace Temperature Curve



SGS CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 30 of 34

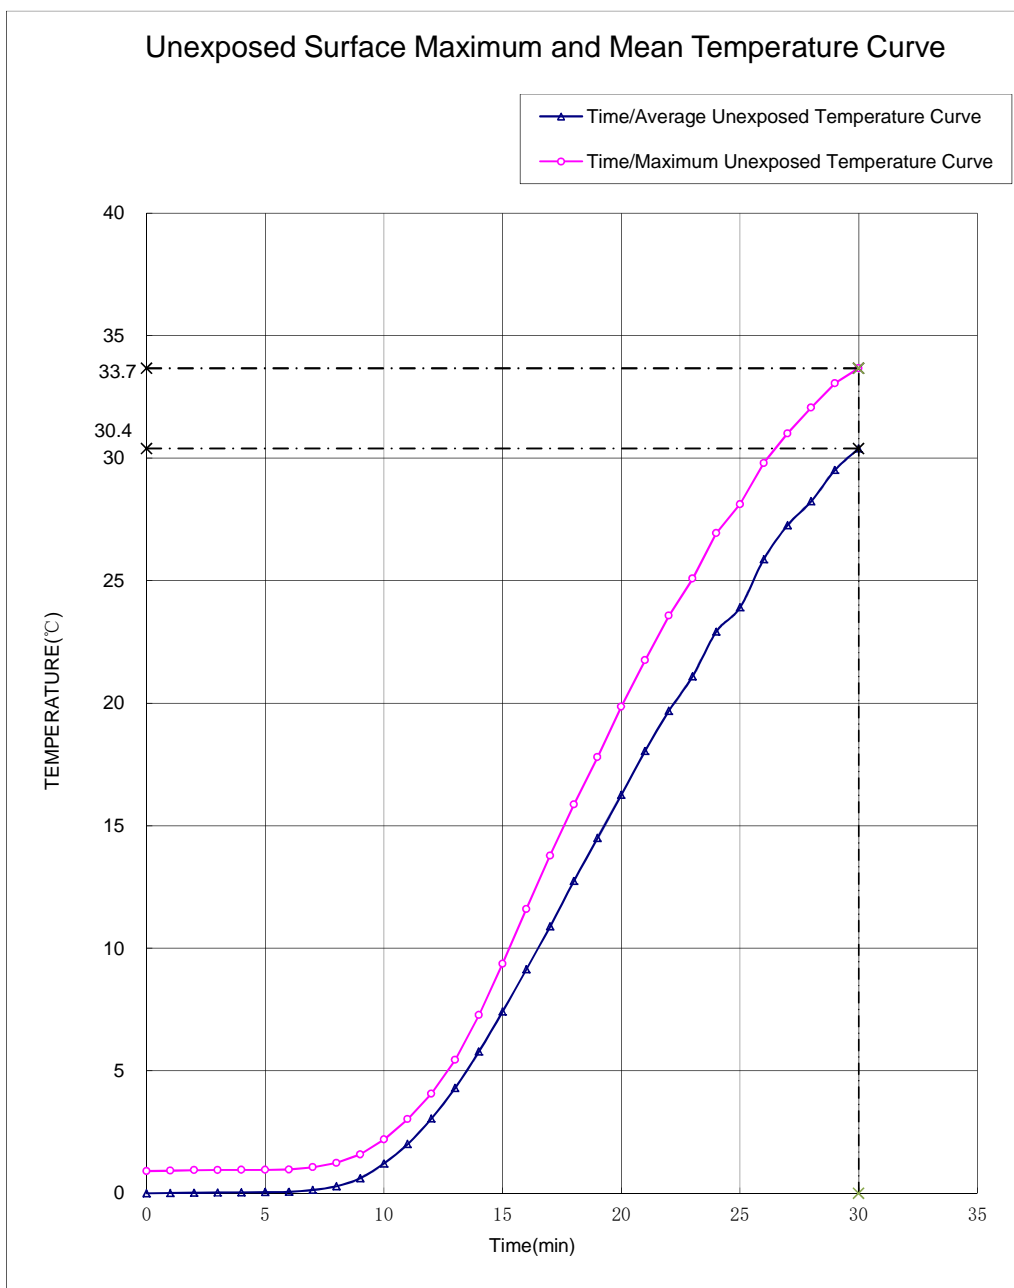


Figure 16 - Unexposed Face Mean and Maximum Temperature Curve



SGS-CSTC 通标标准技术服务有限公司
检验检测专用章
Inspection & Testing Services

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC 通标标准技术服务有限公司
Xiamen Branch Testing Center Commercial Construction Material Laboratory

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 31 of 34

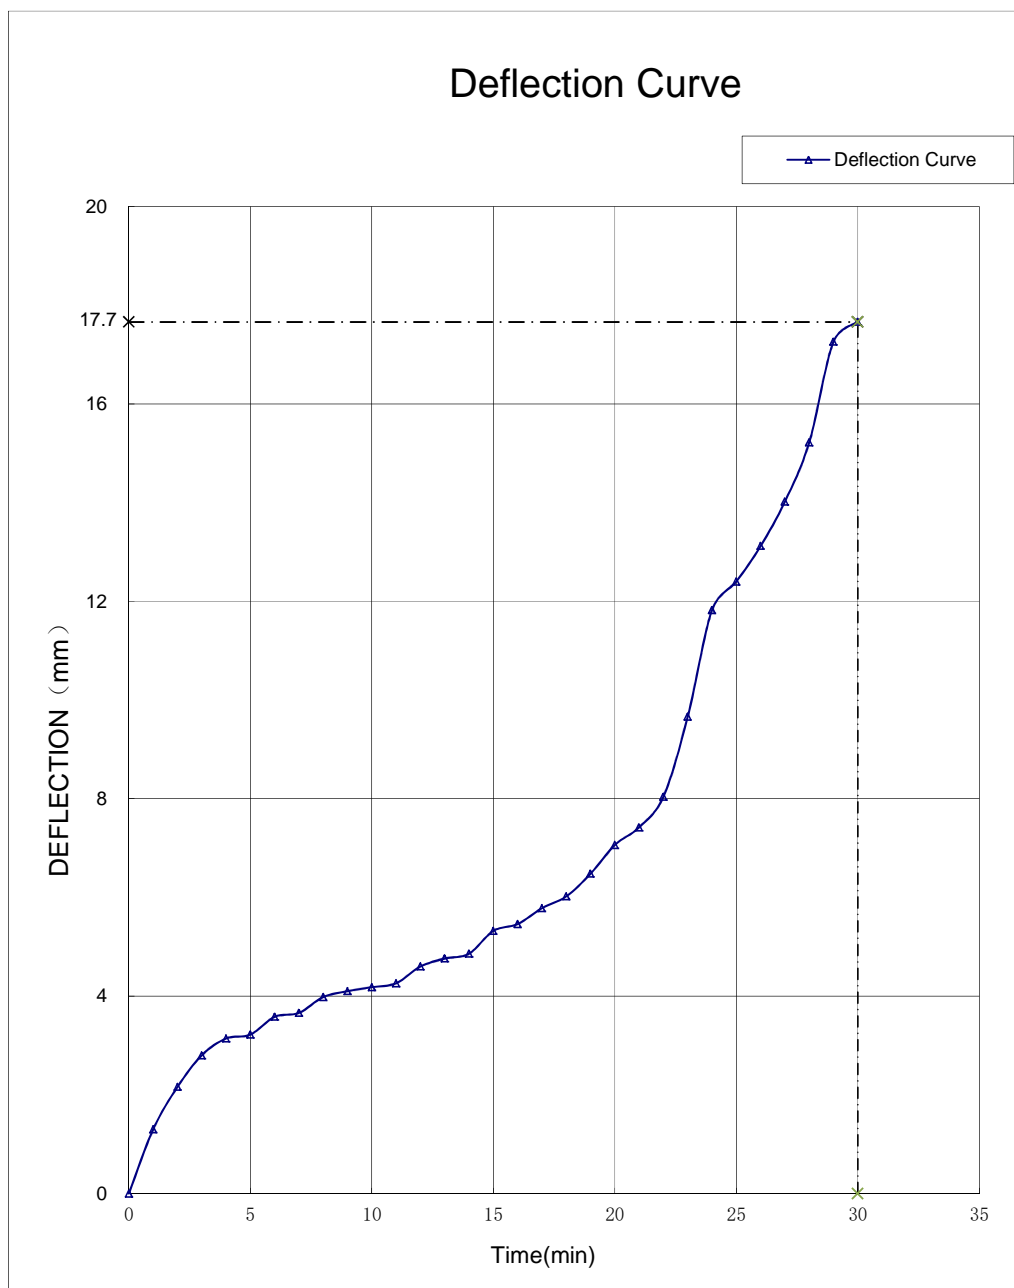


Figure 17 - Deflection Curve



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 32 of 34

Time (min)	Observation (All observations are from the exposed face unless noted otherwise)
0	Test started.
3	Some lens of specimen was fusing.
9	Coating of the plasterboard ceiling fell away.
16	Large areas of coating of the plasterboard ceiling fell away.
28	The plasterboard ceiling started to sag slightly and joints began to open.
30	Test terminated at sponsor's request.

Appendix 1 –Test Observations

Time min	Specified Furnace Temperature ℃	Actual Furnace Mean Temperature ℃
0	20	30
5	576	576
10	678	657
15	739	714
20	781	770
25	815	808
30	842	826

Appendix 2 – Furnace Temperature Records



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 33 of 34

Time min	TC No.201 °C	TC No.202 °C	TC No.203 °C	TC No.204 °C	TC No.205 °C	TC No.206 °C	TC No.207 °C	TC No.208 °C	TC No.209 °C	Mean Temp °C	Mean Temp Rise °C	Max Temp Rise °C
0	30.2	28.1	30.8	30.5	31.0	31.0	30.5	30.7	30.8	30.1	0.0	0.9
5	30.3	28.1	30.9	30.6	31.1	31.0	30.6	30.7	30.8	30.2	0.0	1.0
10	31.4	29.4	31.8	31.8	32.3	31.6	32.2	31.6	31.7	31.3	1.2	2.2
15	37.1	34.9	37.8	39.5	38.4	35.5	38.3	37.0	36.7	37.5	7.4	9.4
20	45.0	42.1	47.7	50.0	47.2	41.8	45.5	45.0	44.1	46.4	16.3	19.9
25	51.3	49.1	56.2	58.2	55.4	48.3	51.6	52.8	50.7	54.0	23.9	28.1
30	58.6	54.9	62.4	63.8	62.9	54.4	57.3	60.5	57.1	60.5	30.4	33.7

Appendix 3 – Unexposed Surface Temperature Records

Time min	TC No. 210 °C	TC No. 211 °C	TC No. 212 °C	TC No. 213 °C	TC No. 214 °C	TC No. 215 °C	TC No. 216 °C	TC No. 217 °C	TC No. 218 °C	TC No. 219 °C	TC No. 220 °C	TC No. 221 °C
0	29.0	30.0	30.1	29.9	30.2	30.9	30.3	30.1	30.2	29.9	29.4	30.1
5	65.0	63.7	63.3	60.9	67.6	68.6	58.1	66.7	68.3	58.9	60.5	66.2
10	89.7	88.0	89.5	87.6	92.4	93.6	90.4	91.9	93.8	88.0	97.0	95.3
15	101.1	101.3	103.0	100.9	104.5	107.8	102.3	105.0	104.3	102.2	110.5	108.3
20	106.3	106.2	106.2	107.3	111.9	111.9	113.8	109.6	110.3	106.2	117.5	117.1
25	114.0	112.7	113.0	116.8	126.7	126.8	117.8	120.3	126.3	116.6	128.8	129.4
30	159.6	155.4	162.7	179.0	184.4	199.0	155.3	199.4	203.5	152.3	162.0	189.1

Appendix 4 – Individual Temperatures Recorded Adjacent to the Spotlight Fittings at Mid-height of the Cavity



SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained herein reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

TEST REPORT

No. : XMIN2208008557CM

Date : Oct 14, 2022

Page: 34 of 34

Time min	Central Vertical Deflection mm	Rate of Deflection mm/min
0	0.0	0.0
5	3.2	0.1
10	4.2	0.1
15	5.3	0.5
20	7.1	0.6
25	12.4	0.6
30	17.7	0.4

Note: 1. A positive value indicates deflection towards to the furnace

Appendix 5 – Deflection of the floor assembly during the test

2. The above test project/method was carried out by subcontractors.

***** End of report*****



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

SGS-CSTC (Singapore) Technical Services Co., Ltd.
Xiamen Branch Testing Center Commercial Construction Material Laboratory

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com