

# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 1 of 27

CUSTOMER NAME: JCC LIGHTING PRODUCTS  
ADDRESS: INNOVATION CENTRE SOUTHERN CROSS TRADING ESTATE BEEDING  
CLOSE BOGNOR REGIS PO22 9TS

Sample Name : DOWNLIGHT  
Client Ref. Info. : Sample A: V50 Fixed Downlight, Type No.: JC1001  
Sample B: V50 Tilt Downlight, Type No.: JC1002  
Sample C: FG2 IP65 Downlight, Type No.: JC94110  
Sample D: FG2 Fixed Downlight, Type No.: JC94113  
Sample E: FG2 Tilt Downlight, Type No.: JC94114

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

\*\*\*\*\*

Test Required : Selected test(s) as requested by applicant  
Date of Receipt : Oct. 29, 2019  
Testing Start Date : Oct. 29, 2019  
Testing End Date : Nov. 20, 2019  
Test result(s) : For further details, please refer to the following page(s)  
(Unless otherwise stated the results shown in this test report refer only to the sample(s) tested)

\*\*\*\*\* To be continued\*\*\*\*\*

Signed for  
SGS-CSTC Standards Technical  
Services Co., Ltd. Xiamen Branch  
Testing Center

Civi Huang Authorized Signatory



SGS-CSTC Standards Technical Services Co., Ltd.  
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com  
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e [sgs.china@sgs.com](mailto:sgs.china@sgs.com)

# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 2 of 27

## Test Summary

To determine the fire resistance of a timber floor assembly protected by a plasterboard ceiling designed to provide 31 minutes fire resistance, incorporating five DOWNLIGHT fittings, when tested in accordance with Clause 7 of BS 476-21:1987 "Fire tests on building materials and structures – Part 21: Methods for determination of the fire resistance of loadbearing elements of construction".

Performance Criteria	Test Results
Loadbearing Capacity	31min (No failure)
Integrity	31min (No failure)
Insulation	31min (No failure)

Note: According to sponsor requirements, the test was discontinued after a period of 31 minutes.

## Sample details and conditioning

The ceiling incorporated five DOWNLIGHT fittings referenced as follows:

Test Ref.	Product Name	Reference	Detail
A	V50 Fixed Downlight	JC1001	See Figure 2
B	V50 Tilt Downlight	JC1002	See Figure 3
C	FG2 IP65 Downlight	JC94110	See Figure 4
D	FG2 Fixed Downlight	JC94113	See Figure 5
E	FG2 Tilt Downlight	JC94114	See Figure 6

The floor assembly had overall nominal dimensions of 4696 mm long by 3200 mm wide. The unexposed surface of the floor comprised 1 layer of 18mm thick Egger Chipboard, the layers was screw fixed to the upside of the floor joists.

The floor assembly was protected on its underside by a direct fixed ceiling, formed from one layers of 15mm thick plasterboard. The layer was screw fixed to the underside of the floor joists.

The floor supported an evenly distributed load of 1075.7 N/m<sup>2</sup>.

\*\*\*\*\* To be continued\*\*\*\*\*



SGS-CSTC Xi'an Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn  
 中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 3 of 27

## Test procedure

The ambient temperature at the beginning of the test was 22 °C.

The furnace temperature was measured by means of nine thermocouples distributed evenly in the furnace, with their measuring junctions 100 mm ± 10 mm from the exposed surface of the specimen. The furnace was controlled so that the mean of the nine thermocouple readings followed as closely as possible the time/temperature relationship specified in Clause 3.1 of BS 476-20:1987.

After the first five minutes of the test, the furnace pressure was maintained at 0±2 Pa at 1,000 mm from the notional floor level.

Thermocouples were provided to monitor the unexposed surface of the floor assembly and the output of all instrumentation was recorded at no less than one minute intervals. The locations and reference numbers of the various unexposed surface and internal thermocouples are shown in Figure 1.

## Test data and information

Details of the specimen structure are shown in Figure 1 to 6. The photographs of the DOWNLIGHTs are shown in Photo 1 to 10.

Photographs of the test are shown in Photos 11 to 19. A summary of the observations made on the general behavior of the specimen is given in Appendix 3.

The mean furnace temperature records are shown in Appendix 4, and the actual time-temperature curve of furnace in relation to the specified time-temperature curve is shown in Figure 7.

The unexposed surface temperature records are shown in Appendix 5, and the individual temperatures recorded adjacent to the spotlight fittings at mid-height of the cavity are shown in Appendix 6. The unexposed surface maximum and mean temperature curve are shown in Figure 8.

The vertical deflection at the centre of the floor assembly was continuously measured during the test, and the data records are given in Appendix 7. The deflection curve is shown in Figure 9.

The Load Calculations is given in Appendix 1.

\*\*\*\*\* To be continued\*\*\*\*\*



# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 4 of 27

## Performance criteria

This test was according to performance criteria which specified in BS 476-21:1987, section 7.6 to determine the loadbearing capacity, integrity and insulation of the specimen:

**Loadbearing capacity:** A failure of the test construction to maintain its loadbearing capacity shall be deemed to have occurred when any of the requirements specified in given as follow are exceeded.

a) a deflection of  $L/20$ , in this test:

$$\text{Limiting deflection} = 4500 / 20 = 225 \text{ (mm); or}$$

b) where the rate of deflection (in mm/min), calculated over 1 min intervals, starting at 1 min from the commencement of the heating period, exceeds the limit set by the following equation:

$$\text{rate of deflection} = \frac{L^2}{9000d}$$

in this test:

$$\text{Limiting rate of deflection} = \frac{(4500)^2}{9000 \times 238} = 9.5 \text{ (mm/min);}$$

Where

L is the clear span of specimen (in mm);

d is the distance from the top of the structural section to the bottom of the design tension zone (in mm).

**Integrity:** A failure of the test construction to maintain integrity shall be deemed to have occurred when collapse or sustained flaming on the unexposed face occurs or the criteria given as follow for impermeability are exceeded.

a) For situations where the cotton pad is suitable, failure shall be deemed to have occurred when flames and/or hot gases cause flaming or glowing of the cotton fiber pad.

b) For situations where the use of the cotton pad is not suitable, failure shall be deemed to have occurred when either:

1) the 6 mm diameter gap gauge can penetrate a through gap such that the end of the gauge projects into the furnace and the gauge can be moved in the gap for a distance of at least 150 mm; or

2) the 25 mm diameter gap gauge can penetrate a through gap such that the end of the gauge projects into the furnace.

\*\*\*\*\* To be continued\*\*\*\*\*





# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 5 of 27

**Insulation:** Failure shall be deemed to have occurred when one of the following occurs:

- a) When the mean unexposed face temperature increases by more than 140°C above its initial value;
- b) When the temperature recorded at any positions on the unexposed face is in excess of 180°C above the initial mean unexposed face temperature;
- c) When integrity failure occurs.

## Conclusions

A specimen of a timber floor assembly protected by a plasterboard ceiling incorporating five DOWNLIGHT fittings has been subjected to a fire resistance test in accordance with BS 476-21:1987, Clause 7.

At the heating period of 31 minutes, the maximum deflection was 16.1 mm; the rate of deflection was 0.5 mm/min. The loadbearing capacity was satisfied.

At the heating period of 31 minutes, there was no collapse of the specimen, no sustained flaming on the unexposed surface and no loss of impermeability. The integrity requirement was satisfied.

At the heating period of 31 minutes, the mean temperature rise of the unexposed face was 35.4°C, the maximum temperature rise of the unexposed face was 38.1°C. The insulation requirement was satisfied.

The floor assemblies satisfied the performance requirements specified in Clause 7 of BS 476-21:1987, for the following periods:

Performance Criteria	Test Results
Loadbearing Capacity	31min (No failure)
Integrity	31min (No failure)
Insulation	31min (No failure)

Note: According to sponsor requirements, the test was discontinued after a period of 31 minutes.

## Remark:

The test results relate only to the specimen tested. Appendix A of BS 476-20 provides guidance information on the application of fire resistance tests and the interpretation of test data. Application of the result to assemblies of different dimensions or supported in other manners or incorporating different components should be the subject of a design appraisal.

\*\*\*\*\* To be continued\*\*\*\*\*



## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 6 of 27

### Appendix 1: Schedule of components

#### 1. Floor Joists

Material : Softwood timber joists  
Overall section size : 45 mm thick×190 mm deep  
Density of Joist: : 600 kg/m<sup>3</sup>

#### 2. Floorboards

Manufacturer : Egger  
Material : Egger Chipboard, E1  
Thickness : 1 no. layer, 18mm thick  
Density : 700 kg/m<sup>3</sup>  
Fixing method : All board joints staggered with respect to adjacent layer and screw fixed to all joists using drywall steel screws, 35 mm long x 3.9 mm diameter screws for the layer, at 200 mm centers along joists and 150 mm centers along perimeter of floor.

#### 3. Ceiling boards

Manufacturer : Knauf  
Material : Gypsum plasterboard  
Thickness : 1 no. layers, each 15mm thick  
Density : 727 kg/m<sup>3</sup>  
Fixing method : All board joints staggered with respect to adjacent layer and screw fixed to all joists using drywall steel screws, 35 mm long x 3.9 mm diameter screws for the layer, at 200 mm centers along joists and 150 mm centers along perimeter of ceiling.

\*\*\*\*\* To be continued\*\*\*\*\*



# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 7 of 27

## 4. Specimen A

Product Name : V50 Fixed Downlight  
 Reference : JC1001 V50 Fixed Downlight  
 Manufacturer : JCC LIGHTING PRODUCTS  
 Type : Recessed Downlight  
 Overall dimensions and construction : See figure 2  
 Hole size in ceiling boards : 70 mm diameter  
 Materials : i. Casing: Mild Steel  
 ii. Cover: Polycarbonate  
 iii. Spring clip: Steel  
 iv. Connection block: Polycarbonate Housing  
 Approx. weight: 0.29 Kg  
 Details of fireproof material : i. Manufacturer: JCC Lighting Products  
 ii. Type: Mild Steel 'can'  
 iii. Thickness: 0.8mm  
 Details of expanding material : i. Manufacturer: Tai-G  
 ii. Type: SM43.5-1.0mm  
 iii. Material: Fire Reactive Expandable Graphite  
 iv. Thickness: 1.0mm  
 v. Location: Top of 'Can'

## 5. Specimen B

Product Name : V50 Tilt Downlight  
 Reference : JC1002 V50 Tilt Downlight  
 Manufacturer : JCC LIGHTING PRODUCTS  
 Type : Recessed Downlight  
 Overall dimensions and construction : See figure 3  
 Hole size in ceiling boards : 85 mm diameter  
 Materials : i. Casing: Mild Steel  
 ii. Cover: Polycarbonate  
 iii. Spring clip: Steel  
 iv. Connection block: Polycarbonate Housing  
 Approx. weight: 0.46 Kg  
 Details of fireproof material : i. Manufacturer: JCC Lighting Products  
 ii. Type: Mild Steel 'can'  
 iii. Thickness: 0.8mm  
 Details of expanding material : i. Manufacturer: Tai-G  
 ii. Type: SM43.5-1.0mm  
 iii. Material: Fire Reactive Expandable Graphite  
 iv. Thickness: 1.0mm  
 v. Location: Top of 'Can'

\*\*\*\*\* To be continued\*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 8 of 27

## 6. Specimen C

Product Name : FG2 IP65 Downlight  
 Reference : JC94110 FG2 IP65 Downlight  
 Manufacturer : JCC LIGHTING PRODUCTS  
 Type : Recessed Downlight  
 Overall dimensions and construction : See figure 4  
 Hole size in ceiling boards : 74 mm diameter  
 Materials : i. Casing: Mild Steel  
 ii. Cover: Mild Steel  
 iii. Spring clip: Steel  
 iv. Connection block: Polycarbonate Housing  
 Approx. weight: 0.27 Kg  
 Details of fireproof material : i. Manufacturer: JCC Lighting Products  
 ii. Type: Mild Steel 'can'  
 iii. Thickness: 0.8mm  
 Details of expanding material : i. Manufacturer: Tai-G  
 ii. Type: SM43.5-1.0mm  
 iii. Material: Fire Reactive Expandable Graphite  
 iv. Thickness: 1.0mm  
 v. Location: Top of 'Can'

## 7. Specimen D

Product Name : FG2 Fixed Downlight  
 Reference : JC94113 FG2 Fixed Downlight  
 Manufacturer : JCC LIGHTING PRODUCTS  
 Type : Recessed Downlight  
 Overall dimensions and construction : See figure 5  
 Hole size in ceiling boards : 74 mm diameter  
 Materials : i. Casing: Mild Steel  
 ii. Cover: Mild Steel  
 iii. Spring clip: Steel  
 iv. Connection block: Polycarbonate Housing  
 Approx. weight: 0.25 Kg  
 Details of fireproof material : i. Manufacturer: JCC Lighting Products  
 ii. Type: Mild Steel 'can'  
 iii. Thickness: 0.8mm  
 Details of expanding material : i. Manufacturer: Tai-G  
 ii. Type: SM43.5-1.0mm  
 iii. Material: Fire Reactive Expandable Graphite  
 iv. Thickness: 1.0mm  
 v. Location: Top of 'Can'

\*\*\*\*\* To be continued\*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)



# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 9 of 27

## 8. Specimen E

Product Name : FG2 Tilt Downlight  
 Reference : JC94114 FG2 Tilt Downlight  
 Manufacturer : JCC LIGHTING PRODUCTS  
 Type : Recessed Downlight  
 Overall dimensions and construction : See figure 6  
 Hole size in ceiling boards : 85 mm diameter  
 Materials :  
 i. Casing: Mild Steel  
 ii. Cover: Mild Steel  
 iii. Spring clip: Steel  
 iv. Connection block: Polycarbonate Housing  
 Approx. weight: 0.32 Kg  
 Details of fireproof material :  
 i. Manufacturer: JCC Lighting Products  
 ii. Type: Mild Steel 'can'  
 iii. Thickness: 0.8mm  
 Details of expanding material :  
 i. Manufacturer: Tai-G  
 ii. Type: SM43.5-1.0mm  
 iii. Material: Fire Reactive Expandable Graphite  
 iv. Thickness: 1.0mm  
 v. Location: Top of 'Can'  
 \*\*\*\*\* To be continued\*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 10 of 27

## Load Calculations

### 1. Physical Parameters of Timber Joists

Measured Joist dimensions : 190 mm deep by 45 mm thick  
 Mean spacing : 640 mm  
 Effective span : 4500 mm  
 Density of Joist : 600 kg/m<sup>3</sup>

### 2. Physical Parameters of Floorboards

Thickness : 1 layers, 18 mm thick  
 Density : 700 kg/m<sup>3</sup>

### 3. Physical Parameters of Ceiling boards

Thickness : 1 layers, 15 mm thick  
 Density : 727 kg/m<sup>3</sup>

### 4. Weight of Actual Timber Joists

Actual volume of Joist : 0.286 m<sup>3</sup>  
 Actual weight of Joist : 171.6 kg

### 5. Weight of Actual Floorboards

Actual volume of Floorboards : 0.243 m<sup>3</sup>  
 Actual weight of Floorboards : 170.1 kg

### 6. Weight of Actual Ceiling boards

Actual volume of Floorboards : 0.202 m<sup>3</sup>  
 Actual weight of Floorboards : 147.2 kg

### 7. Actual Dead Weight

Actual Dead Weight of overall specimen : 488.9 kg

### 8. Actual Dead Load

Actual Dead Load per metre square : (488.9×9.81)/(4.5×3.0)  
 355.3 N/m<sup>2</sup>, 36.2 kg/m<sup>2</sup>

### 9. Imposed Load

Imposed Load per meter square : (1480.3×9.81)/(4.5×3.0)  
 1075.7 N/m<sup>2</sup>, 109.7 kg/m<sup>2</sup>

Remark:

1. All values are nominal unless stated otherwise.
2. All other details are as stated by the sponsor.

\*\*\*\*\* To be continued\*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com


## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 11 of 27

### Appendix 2: Details of test specimen

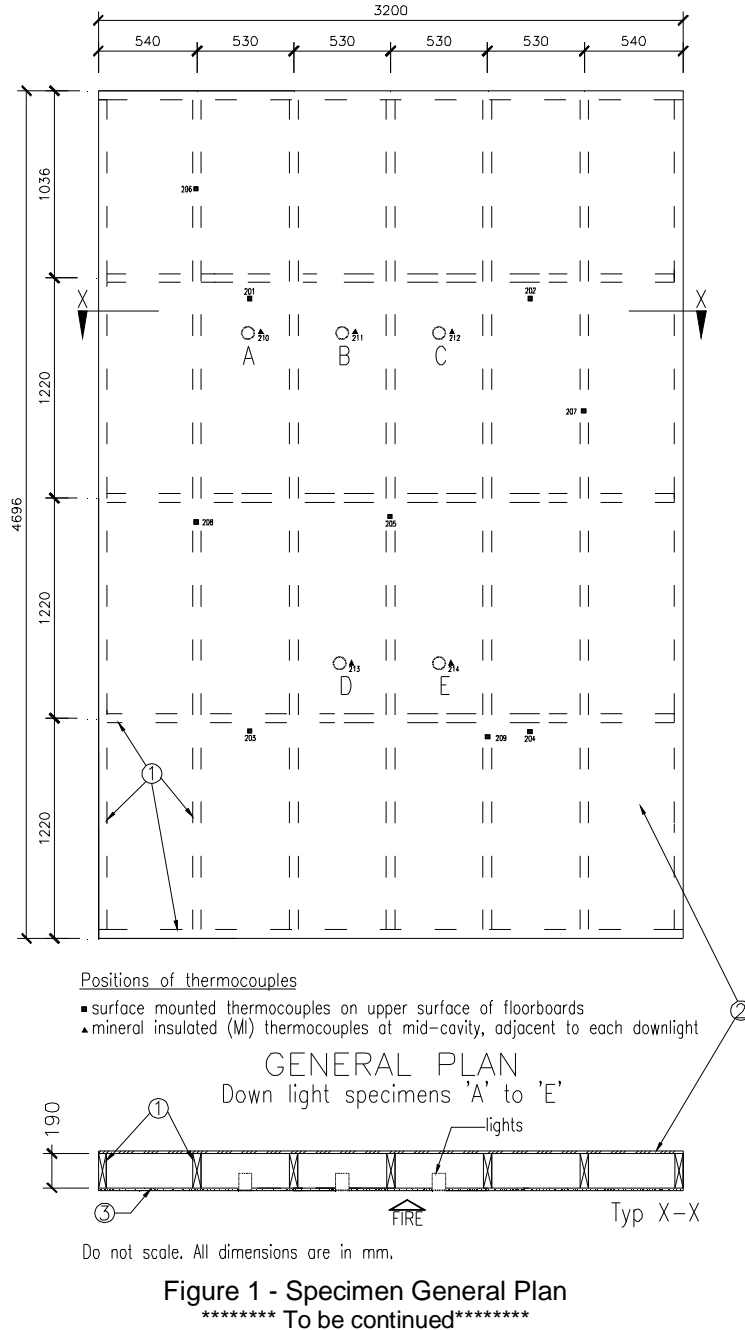

## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 12 of 27

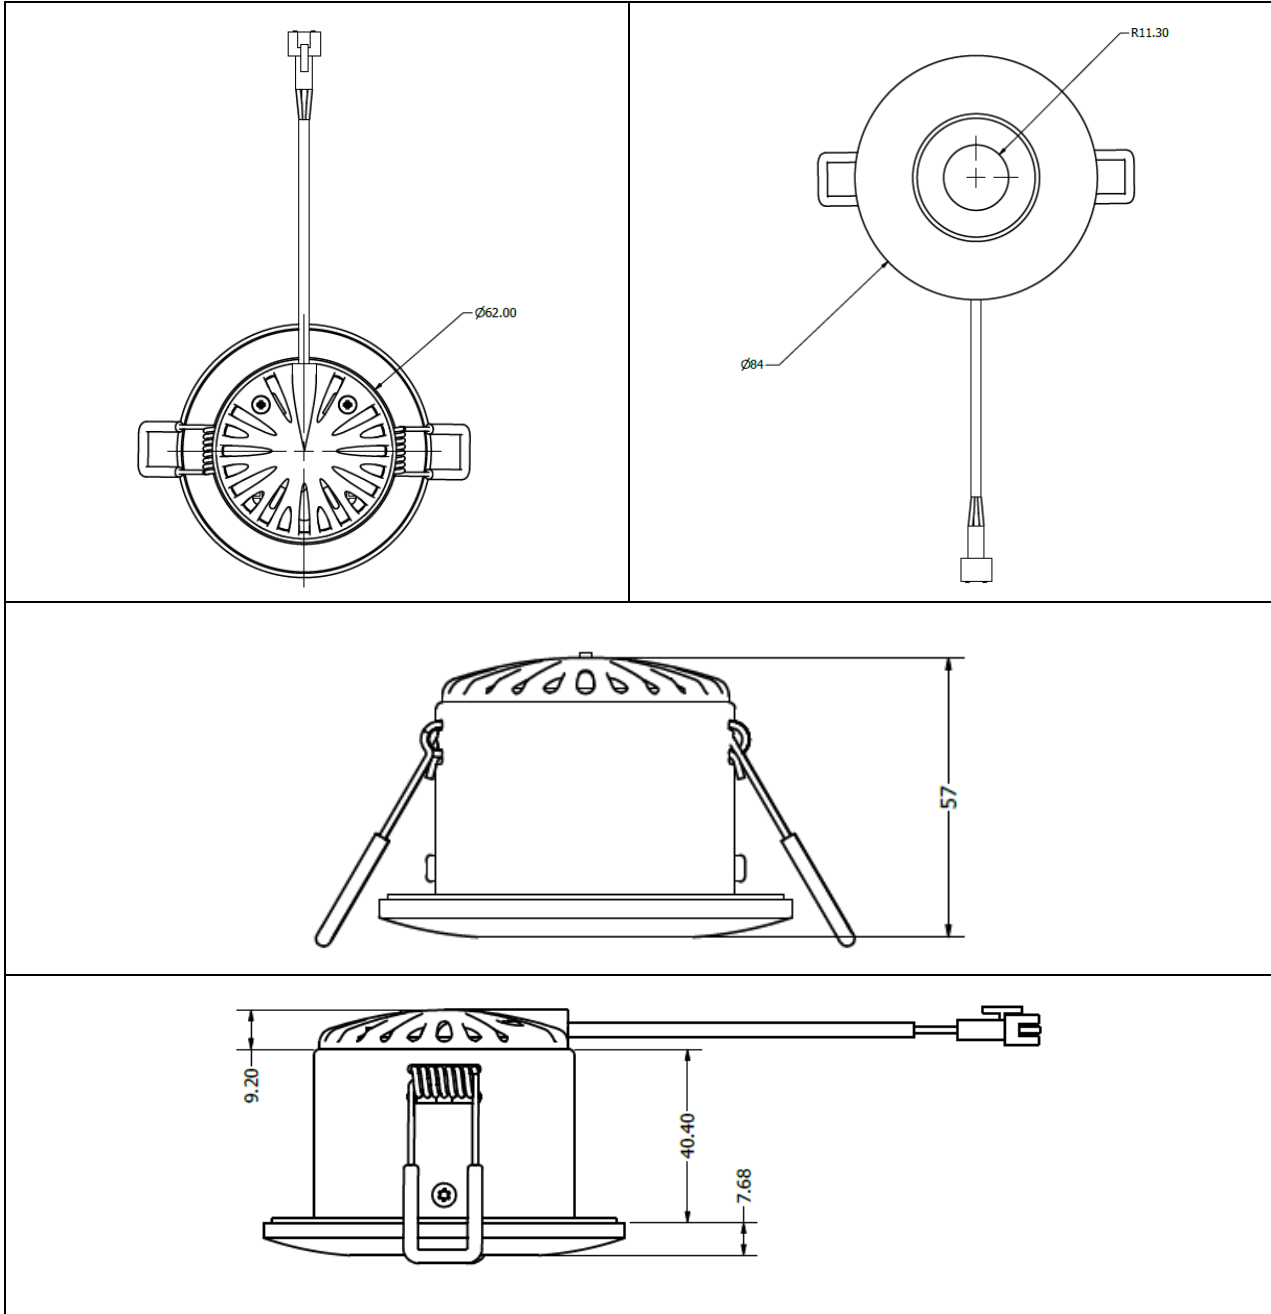


Figure 2 – Details of specimen 'A'

\*\*\*\*\* To be continued\*\*\*\*\*



## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 13 of 27

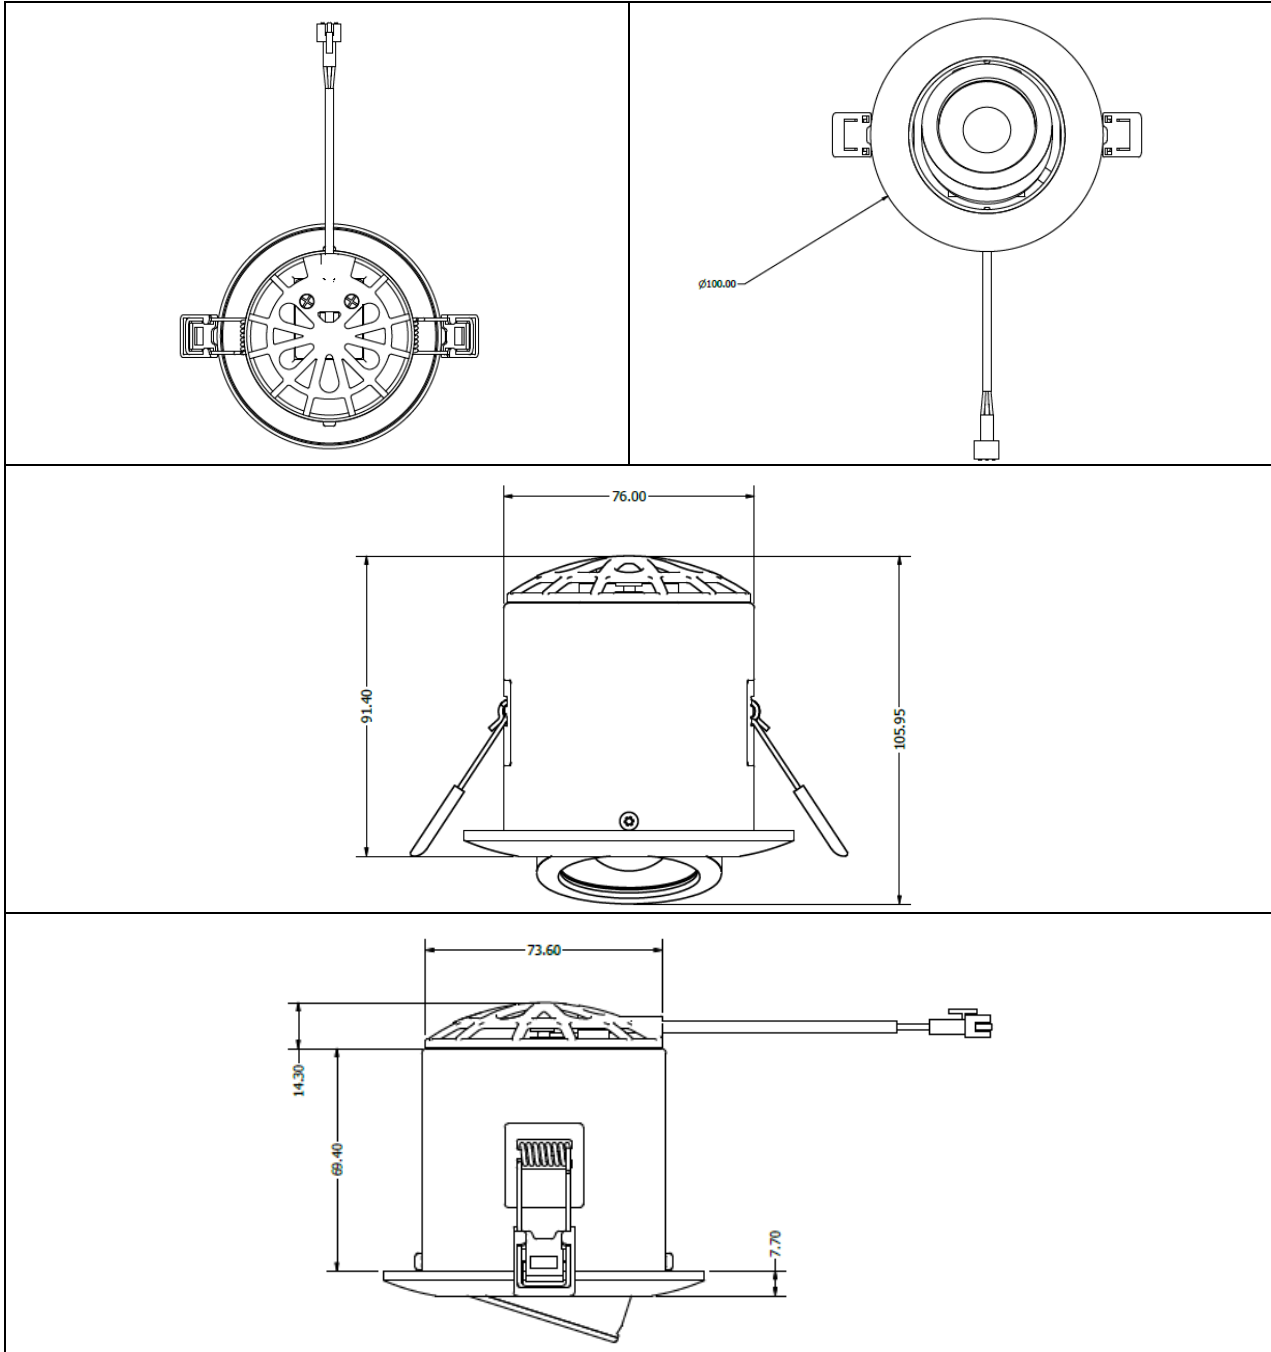


Figure 3 -Details of specimen 'B'  
\*\*\*\*\* To be continued\*\*\*\*\*





## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 14 of 27

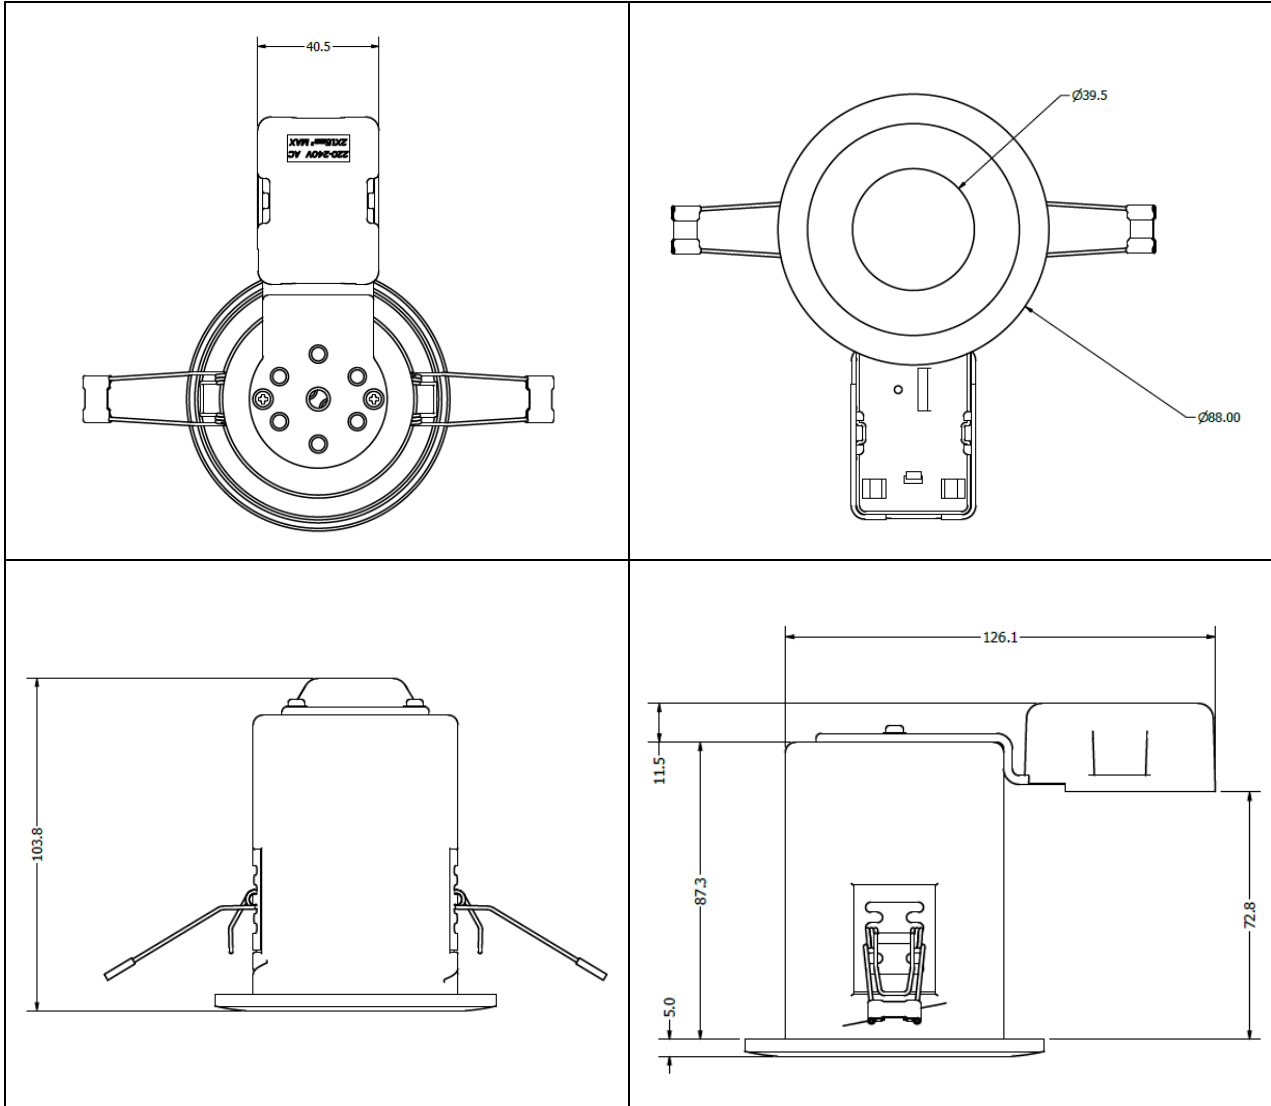


Figure 4 -Details of specimen 'C'

\*\*\*\*\* To be continued\*\*\*\*\*



## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 15 of 27

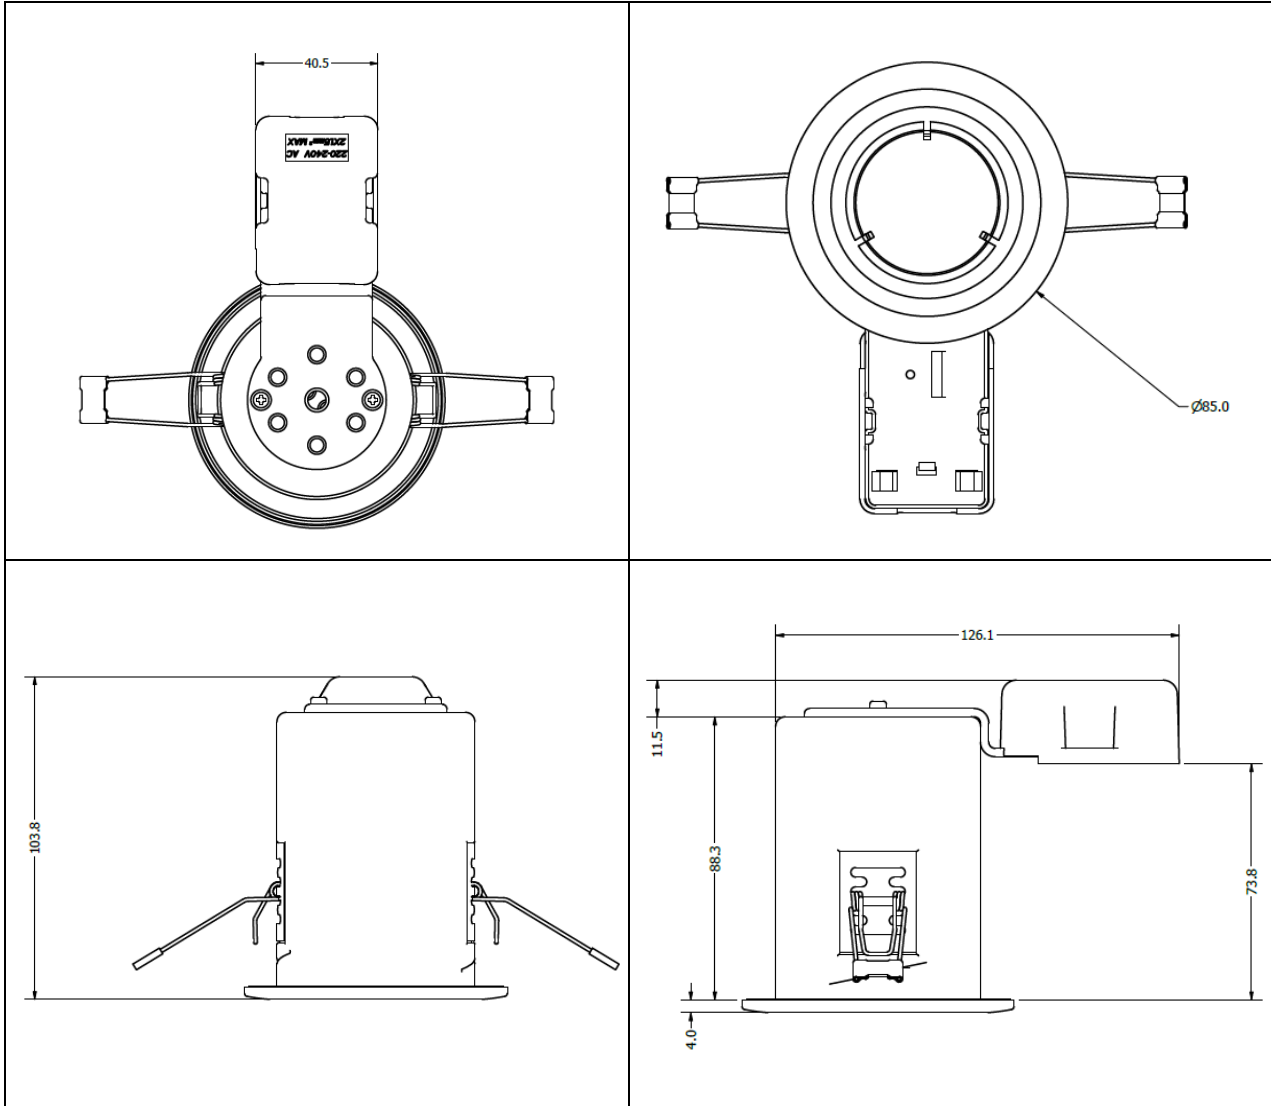


Figure 5 –Details of specimen 'D'

\*\*\*\*\* To be continued\*\*\*\*\*



## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 16 of 27

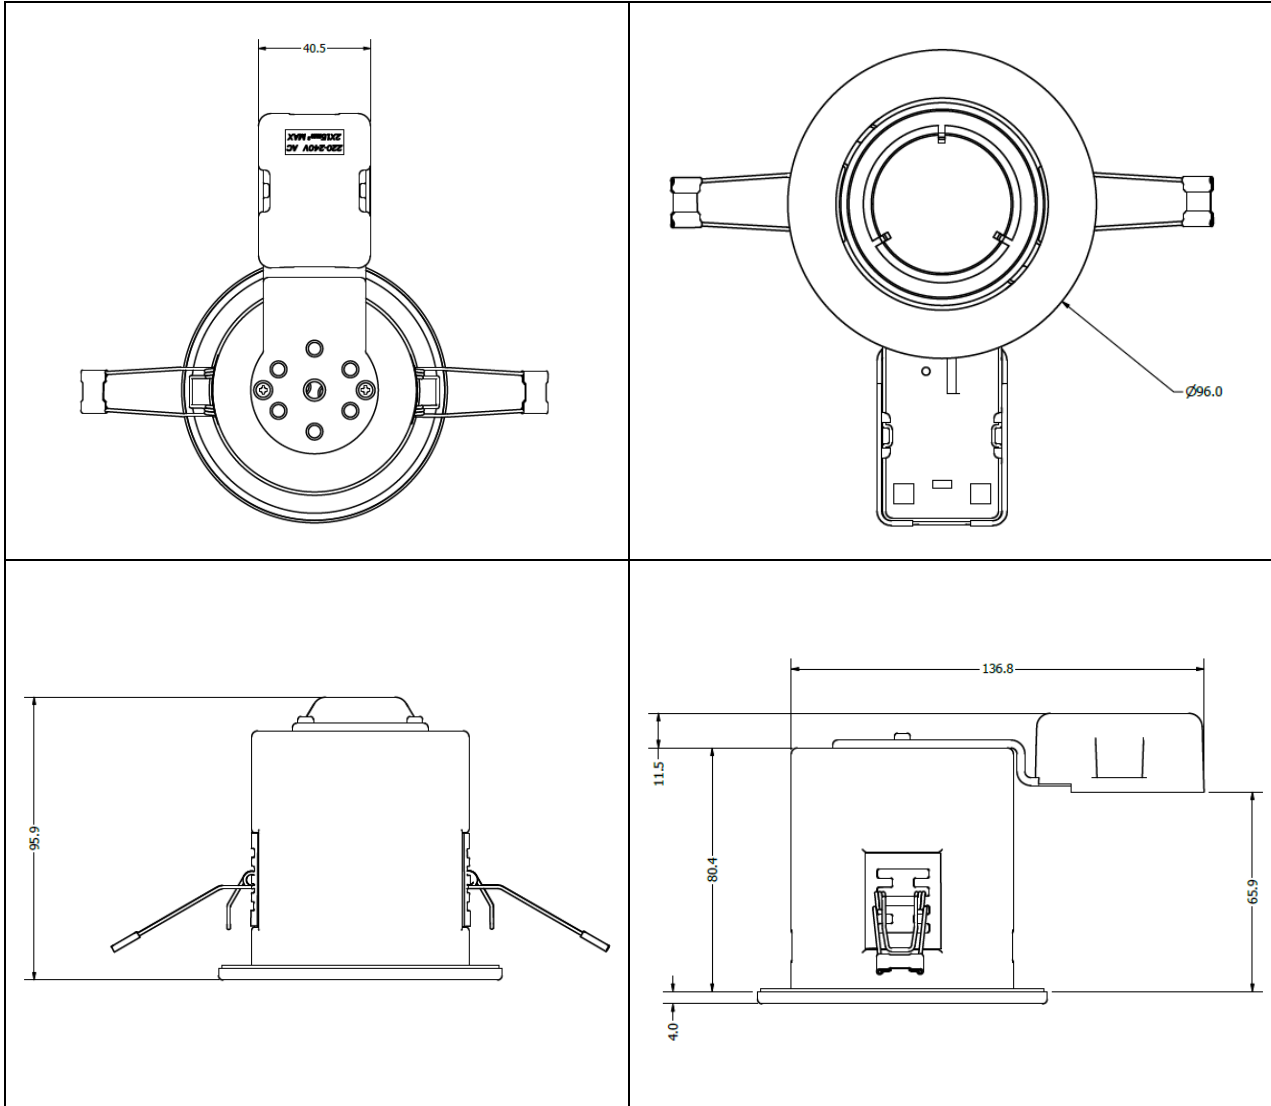


Figure 6 –Details of specimen ‘E’

Note: the specimen details provided by the sponsor

\*\*\*\*\* To be continued\*\*\*\*\*




## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 17 of 27

Figure 7 - Furnace Temperature Curve

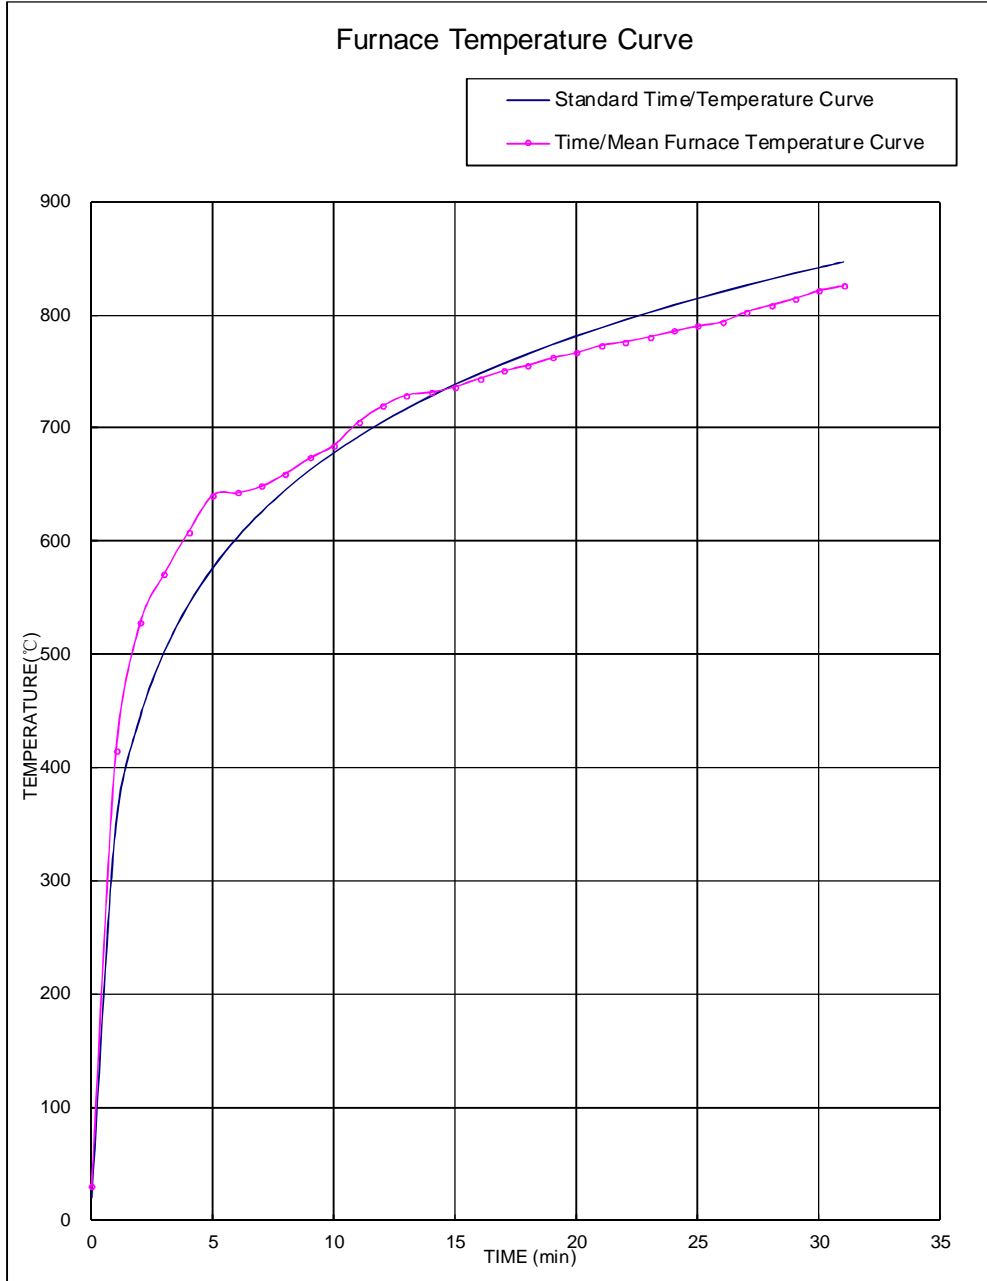

\*\*\*\*\* To be continued\*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com


## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 18 of 27

Figure 8- Unexposed Face Mean and Maximum Temperature Curve

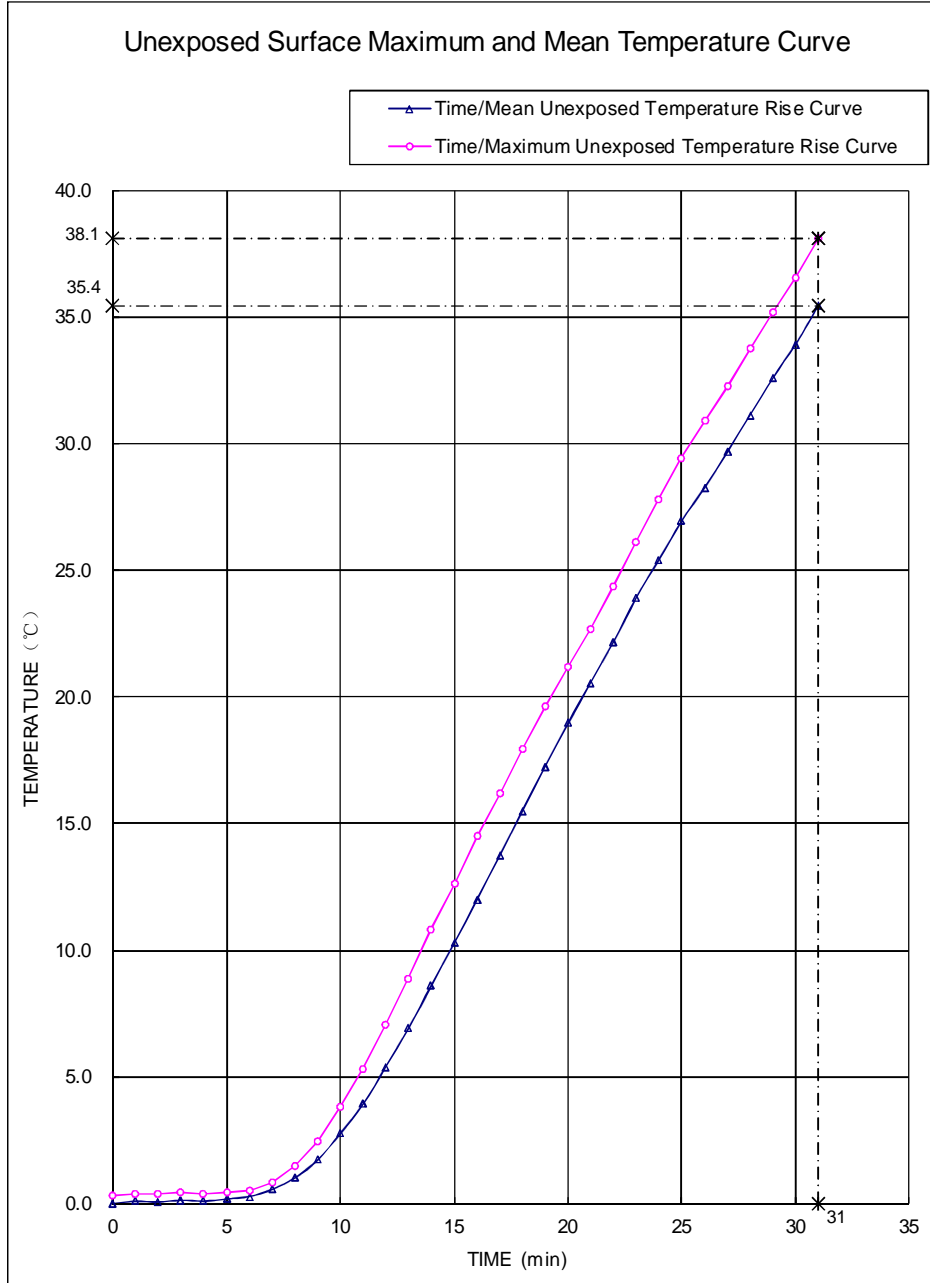

\*\*\*\*\* To be continued\*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

SGS-CTC (Singapore) Technical Services Co., Ltd.  
Xiamen Branch Testing Center Commercial Construction Material Laboratory

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com  
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e [sgs.china@sgs.com](mailto:sgs.china@sgs.com)




## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 19 of 27

Figure 9- Deflection Curve

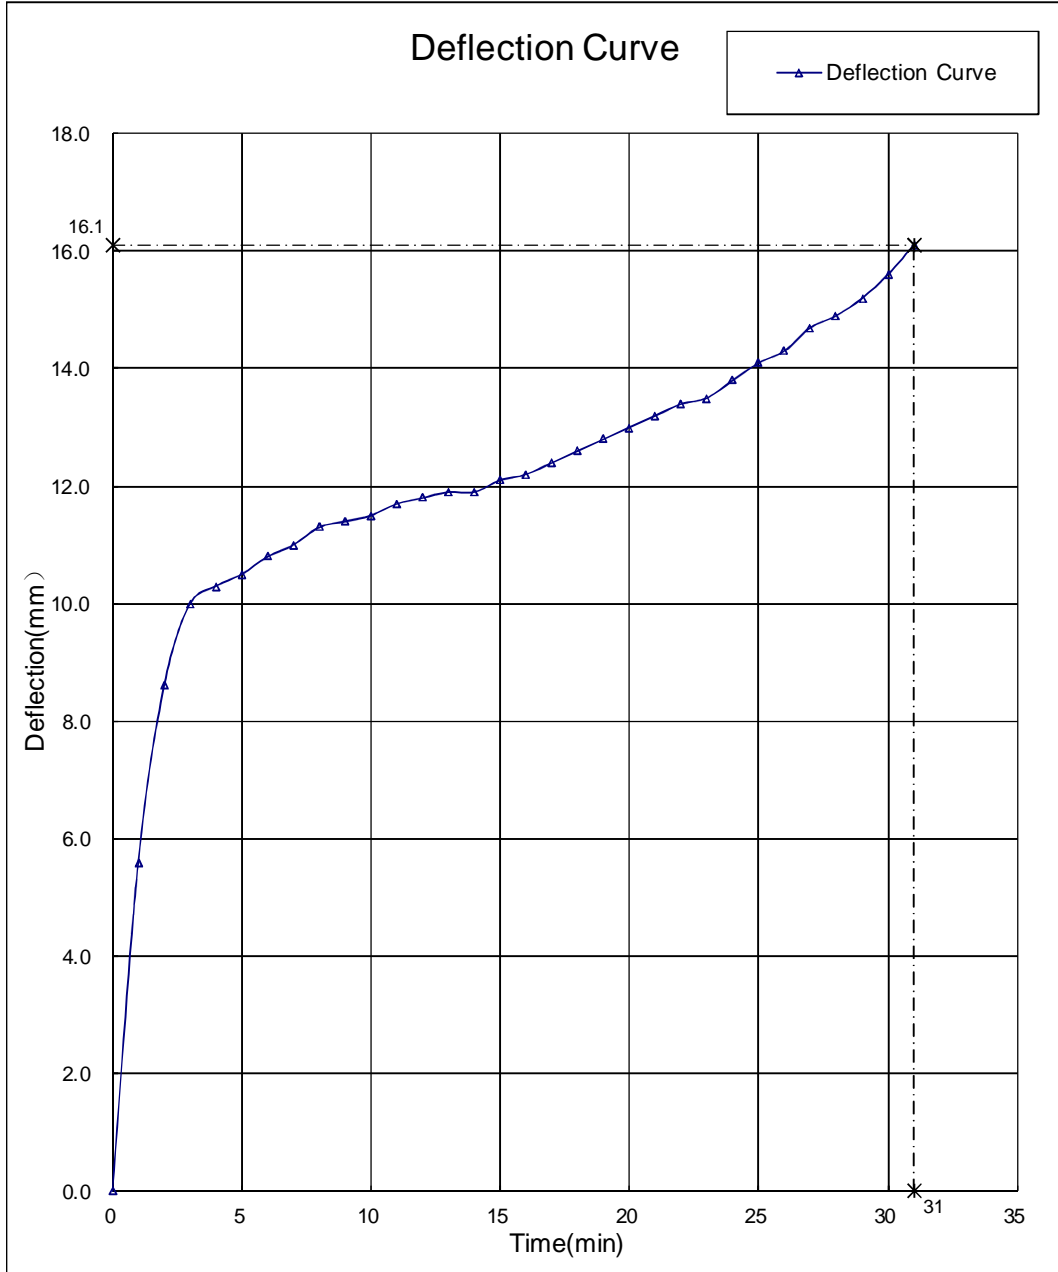

\*\*\*\*\* To be continued \*\*\*\*\*



SGS-CSTC (Singapore) Technical Services Co., Ltd.  
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn  
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 20 of 27

## Appendix 3 –Test Observations

Time (min)	Observation (All observations are from the exposed face unless noted otherwise)
0	Test started.
3	The lens of specimens 'B' fused.
4	The lens of specimens 'A' fused.
10	Smoke released from the perimeter of the specimen.
13	Coating of the plasterboard ceiling fell away.
15	The faceplate of specimens 'A','C' and 'E' already fell away.
22	The lamp cup of specimen 'E' fell out from the light can.
25	Some cracks appeared on the plasterboard ceiling.
27	The faceplate of specimens 'B' already fell away.
31	Test terminated at sponsor's request.

## Appendix 4 – Furnace Temperature Records

Time min	Specified Furnace Temperature °C	Actual Furnace Mean Temperature °C
0	20	29
5	576	641
10	678	685
15	739	737
20	781	767
25	815	790
30	842	821
31	847	826

\*\*\*\*\* To be continued\*\*\*\*\*



SGS-CSTC Shanghai Technical Services Co., Ltd.  
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn  
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com

# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 21 of 27

## Appendix 5 –Unexposed Surface Temperature Records

Time min	TC No.201 °C	TC No.202 °C	TC No.203 °C	TC No.204 °C	TC No.205 °C	TC No.206 °C	TC No.207 °C	TC No.208 °C	TC No.209 °C	Mean Temp °C	Mean Temp Rise °C	Max Temp Rise °C
0	21.2	21.4	21.3	21.1	21.6	21.1	21.2	21.4	21.1	21.3	0.0	0.3
5	21.3	21.6	21.5	21.3	21.8	21.2	21.3	21.5	21.2	21.5	0.2	0.5
10	23.9	25.1	25.1	23.5	22.7	22.0	22.9	23.3	22.6	24.1	2.8	3.8
15	32.4	33.9	33.2	30.8	27.5	25.4	28.1	29.5	28.3	31.6	10.3	12.6
20	42.1	42.5	41.7	39.3	35.7	30.4	34.3	37.5	37.1	40.3	18.9	21.2
25	50.7	49.5	48.6	47.0	45.3	36.2	40.1	45.4	45.6	48.2	26.9	29.4
30	57.8	55.1	55.8	54.4	53.0	41.8	45.2	51.6	52.1	55.2	33.9	36.5
31	59.4	56.5	57.3	56.3	54.1	42.9	46.3	52.3	53.2	56.7	35.4	38.1

## Appendix 6 – Individual Temperatures Recorded Adjacent to the Spotlight Fittings at Mid-height of the Cavity

Time min	TC No.210 °C	TC No.211 °C	TC No.212 °C	TC No.213 °C	TC No.214 °C
0	21.9	21.2	21.2	21.7	22.0
5	60.9	63.4	57.9	63.5	66.4
10	88.2	84.8	82.7	87.0	90.6
15	101.9	93.7	94.9	101.7	101.1
20	109.4	101.8	103.9	109.6	108.9
25	150.4	162.8	127.0	165.5	163.7
30	201.2	210.3	196.0	214.6	224.9
31	209.9	220.8	196.6	222.0	239.2

\*\*\*\*\* To be continued\*\*\*\*\*



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

# TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 22 of 27

## Appendix 7 - Deflection of the floor assembly during the test

Time min	Central Vertical Deflection mm	Rate of Deflection mm/min
0	0.0	0.0
5	10.5	0.2
10	11.5	0.1
15	12.1	0.2
20	13.0	0.2
25	14.1	0.3
30	15.6	0.4
31	16.1	0.5

Note:

1. A positive value indicates deflection towards to the furnace
2. The above test was carried out by Guangzhou Building Materials Institute Limited Company.

\*\*\*\*\* To be continued\*\*\*\*\*



SGS-CSTC Xi'an Branch Testing Center  
Xi'an Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn  
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e [sgs.china@sgs.com](mailto:sgs.china@sgs.com)



## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 23 of 27

### Photo Appendix:



Photo 1: Front view of specimen 'A'



Photo 2: Side view of specimen 'A'

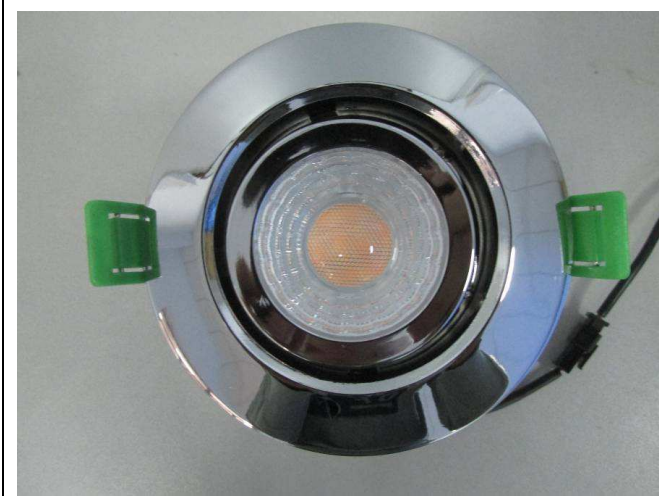


Photo 3: Front view of specimen 'B'



Photo 4: Side view of specimen 'B'

\*\*\*\*\* To be continued\*\*\*\*\*



SGS-CSTC Inspection & Testing Services  
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Document.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn  
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com



## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 24 of 27



Photo 5: Front view of specimen 'C'



Photo 6: Side view of specimen 'C'



Photo 7: Front view of specimen 'D'



Photo 8: Side view of specimen 'D'

\*\*\*\*\* To be continued\*\*\*\*\*



## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 25 of 27



Photo 9 : Front view of specimen 'E'



Photo 10: Side view of specimen 'E'



Photo 11: The exposed surface of the specimen before the test



Photo 12: The unexposed surface of the specimen before the test.

\*\*\*\*\* To be continued\*\*\*\*\*



SGS-CSTC (Singapore) Technical Services Co., Ltd.  
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn  
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e [sgs.china@sgs.com](mailto:sgs.china@sgs.com)



## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 26 of 27



Photo 13: The exposed surface of the specimen after test duration of 3 minutes, showing the lens of specimen was fusing.



Photo 14: The unexposed surface of the specimen after test duration of 15 minutes.



Photo 15: The exposed surface of the specimen after test duration of 16 minutes, showing the bezel of specimen fused



Photo 16: The exposed surface of the specimen after test duration of 22 minutes, showing the lamp cup of specimen fell out from the light can

\*\*\*\*\* To be continued\*\*\*\*\*



SGS-CSTC Inspection & Testing Services  
Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: [CN.Doccheck@sgs.com](mailto:CN.Doccheck@sgs.com)

No.31 Xianghong Road, Xiang'an Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgsgroup.com.cn  
中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e [sgs.china@sgs.com](mailto:sgs.china@sgs.com)

## TEST REPORT

No. : XMIN191002621CCM

Date : Dec.02, 2019

Page: 27 of 27



Photo 17: The unexposed surface of the specimen after test duration of 30 minutes



Photo 18: The exposed surface of the specimen after the test.



Photo 19: The unexposed surface of the specimen after the test

SGS authenticate the photo on original report only  
 \*\*\*\*\* End of report\*\*\*\*\*



SGS-CSTC (Singapore) Technical Services Co., Ltd.  
 Xiamen Branch Testing Center Commercial Construction Material Laboratory

Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at <http://www.sgs.com/en/Terms-and-Conditions.aspx> and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <http://www.sgs.com/en/Terms-and-Conditions/Terms-e-Documents.aspx>. Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.

Attention: To check the authenticity of testing / inspection report & certificate, please contact us at telephone: (86-755) 8307 1443, or email: CN.Doccheck@sgs.com

No.31 Xianghong Road, Xiang'An Torch Industrial Zone, Xiamen, Fujian Province, China. 361101 t (86-592) 5765857 f (86-592) 5765380 www.sgs.com.cn  
 中国·福建·厦门·火炬(翔安)产业区翔虹路31号 邮编:361101 t (86-592) 5765857 f (86-592) 5765380 e sgs.china@sgs.com